









Lucknow, Coonoor, Vadodara, Delhi, and Kolkata. These centers offer tailor-made classroom courses and lab learning experiences for technicians, customers,

With a deep national presence and one of the largest electrical distribution networks, comprising over 1500 partners across the country, we are committed to driving excellence and delivering superior products and solutions that power

engineers, professionals, and students.

India's growth journey.

# Index

STANDARDS & APPROVALS		5
OVERVIEW		6
RANGE FEATURES		7
MCCBS FOR POWER DISTR	IBUTION	8
RELEASE FEATURES		10
ACCESSORIES		23
INTERNAL ACCESSORIES		24
EXTERNAL ACCESSORIES		28
PLUG-IN MODULE		29
MECHANICAL INTERLOCK (	(MIL)	34
TERMINATIONS		37
MODULES		38
EXTERNAL NEUTRAL SENS	OR	42
ADDITIONAL TECHNICAL IN	IFORMATION	43
CHARACTERISTIC CURVES		45
DIMENSIONS		53

#### **FEATURES TO MEET EVERY APPLICATION**

#### **Contact System**

- > Double Break with low let-through energy
- > High Breaking Capacity up to 200kA @ 415V AC
- > 100kA @690V AC at 100% Ics
- > 50kA @ 800V AC offering for Solar PV String inverters
- 1000V/1500V PV DC Offering

#### Mechanism

- Class II Front Facia
- > Double Insulation
- > Positive Isolation
- High Electrical and Mechanical Life



#### **Thermal - Magnetic Release**

- > Extended Overload Setting of 67%
- > 16A to 800A Offering
- > Ambient Temperature Compensation
- > Suitable for wide temperature range

#### **Electronic Release**

- > Extended Overload Setting of 25%
- > Individual Fault Indication LEDs
- > Battery Operated In-built Display
- > Advanced Metering and Protection
- Motor Protection Variant with effective Type 2 Coordination

#### **Modular Architecture**

- > Compact Size
- › Late Personalization
- > Interchangeability of Releases
- > Reduced Inventory for internal accessories

#### **Modules**

- > Temperature Monitoring & Protection
- > Zone Selective Interlocking for effective Selectivity
- > Communication Module for metering & control
- > Remote Operation for Motorized MCCB
- Breaker Status, Alarm & Trip with Records

#### **CONNECTED TO DRIVE ENERGY EFFICIENCY**



**Data Analytics** 

**Trend Analysis** 

**Real Time** Monitoring

**Status & Control** 

**Metering & Protection** 

**Data Acquisition** 

## **FUTURE READY FOR COMPLIANCE AND NEW APPLICATIONS**



























## **RESILIENT FOR BETTER SAFETY AND MAINTENANCE**







Inventory & Application friendly Internal Accessories





Reduced Downtime with Plug-in & Drawout Modules





Multiple options for Mechanical Interlocking



Robust Rotary & Electrically Operated Mechanisms

Shrouds for increased personnel safety

Versatile Range of Terminations































# **Standards & Approvals**

# Dsine DZ range of MCCBs and Accessories comply with following international standards

1.IEC 60947-1, EM 60947-1, IS/IEC 60947-1

Low voltage switchgear and controlgear, Part1: General Rules

2.IEC 60947-2. EM 60947-2. IS/IEC 60947-2

Low voltage switchgear and controlgear, Part2: Circuit Breakers

3.IEC 60947-3, EM 60947-3, IS/IEC 60947-3

Low voltage switchgear and controlgear, Part3: Switches, disconnectors, switch - disconnectors and fuse combination units.

#### 4.IEC 6094 7-4, EM 60947-4, IS/IEC 60947-4

Low voltage switchgear and controlgear, Part4: Contactors and motor starters

Third party certificates (ERDA/CPRI) are available for dsine DZ range of MCCBs

#### **NABL**

NABL accreditation acknowledges the technical proficiency of testing, calibration, or medical laboratories for specific tasks in accordance with the ISO/IEC 17025:2005 Standard. Accredited laboratories are obligated to consistently meet the criteria of laboratory accreditations, which are assessed during Surveillance and Re-assessment visits by NABL. Additionally, accredited laboratories must demonstrate their technical

expertise through successful participation in recognized Proficiency Testing Programs.

Lauritz Knudsen Switchgear Testing lab holds NABL accreditation, contingent upon ongoing satisfactory adherence to the aforementioned standard and additional NABL requirements. All dsine DZ range MCCBs undergo testing in Lauritz Knudsen NABL accredited Switchgear Testing Lab.

## **CE Marking**

The CE marking signifies that a product meets the essential requirements of relevant European laws or directives concerning safety, health, environment, and consumer protection. Typically, this conformity with directives is achieved through self-declaration and is mandatory for products in the European Economic Area (EEA) to facilitate trade among member countries. The responsibility for affixing the CE marking lies with the manufacturer or their authorized representative within the EEA. This marking allows manufacturers to demonstrate

compliance with a common set of laws required by all EEA countries, enabling free trade movement within the EEA. Regarding Lauritz Knudsen dsine DZ range of MCCBs, it conforms to the low voltage directive 73/23/EEC as amended by directive 93/68/EEC, if it is used for its intended application and is installed and maintained in accordance with professional practices, relevant installation standards, and operating instructions.

# **IECEE CB SCHEME - DEKRA (KEMA) certified**

The IECEE CB Scheme represents a mutual agreement between participating countries and certification organizations. When a manufacturer uses a CB test certificate from an accepted National Certification Body (NCB), they can receive certification marks from those NCBs in the countries where they are located. Lauritz Knudsen dsine DZ range of MCCBs has been

certified for the IECEE CB Scheme by DEKRA (KEMA), a globally recognized organization with 150 years of experience in testing, inspection, certification, risk management, and verification.

## **Committed to Environment**

dsine DZ MCCB range complies to RoHS & REACh directives. Smaller footprint, usage of green plastics and halogen free flame retardants, recyclable packaging, low carbon footprint, declaration of PEP & EoLI ensures our commitment towards

environment during manufacturing, distribution, installation, use phase and end of life of the product.

# **Overview**

#### 1) Double Break Contact System

- a. Compression spring based flipped lock current limiting contact system design
- b. Improved contact dynamics
  - Flipped lock mechanism accelerates the opening of contacts during short circuit
  - ii. Higher angular and linear opening per break
- c. Improved contact dynamics facilitate
  - i. Low Let through energy
  - ii. Minimum Cut-off Current
  - iii. Higher Voltage breaking capacities
- d. erosion compensation continuous service
- e. Higher Electrical Life
- f. The entire current carrying path is optimised for low watt loss

#### 2) Modular Mechanism

- a. Quick make, break and trip operations
- b. Suitability Positive Isolation
  - i. True indication of Contact system
  - ii. Ensure Customer's safety
- c. Trip Free mechanism
- d. Higher Mechanical life

## 3) Arc Chamber

a. Optimal design of Arc chamber facilitating efficient and faster Arc quenching even at higher voltage and higher amplitude

## 4) Electronic Trip Unit

- a. Electronic Trip unit family cover entire protection schemes of Electrical system
- b. Suitable for 16 A to 1000 A
- c. Available from basic LS/IN to high end energy metering & communication versions

- d. Dedicated Motor protection ETU for entire range
- e. High end versions of ETU family are able to
  - i. Communicate communication module
  - ii. Ensure Zone selectivity ZSI module
  - iii. Temperature monitoring and protection using Temperature module

#### 5) Thermal Magnetic Release

- a. Suitable for 16 A to 800 A
- b. Wide range of overload protection starting form 67% to 100% In
- Inbuilt Ambient Temperature Compensation mechanism to ensure same tripping characteristics for wide range of operating temperature

## 6) Module Integration

- a. Modular Architecture
- b. No load-line biasing
  - Either side of MCCB terminals can be used as Load or Line
- c. More number of internal accessories for better control
- d. Class II insulation from front facia cutout region

# Range Features

- > Range from 16A to 1000A
- > In 3 pole & 4 pole
- > Breaking capacities up to 200kA @ 415Vac
- > Protection using both thermal magnetic and Electronic based releases
- > Various types of terminations
- > Fixed and withdrawable versions#
- > MCCBs for Motor backup protection

- > MCCBs for Distribution and SD versions
- > MCCBs for DC applications
- > High electrical and mechanical life
- > Wide range of operational voltages
- > Wide range of common Internal and External accessories
- Conforms to IS/IEC 60947-2, IEC 60947-2, IEC 60068 and EN 60947-2
- > RoHS and REACh compliance



# **MCCBs** for **Power Distribution**

Frame			DZ0-	125A	Г	DZ1-160	1	)Z1-20	0		DZ2-160	)		D74	1-250A					DZ6-400	)					D7	7-800					D <b>7</b> 7	-1000	
Туре			C	D	С	D N	_	D		D			D			. R	D	N I				V Y Z	D	N	Н	L	R	W	Υ	Z	D		Н	L
Current Range In (A)			16/20/ 40/50 80/10	/25/32/ 0/63/	25/32/ 16 <sup>°</sup> /20 <sup>°</sup> /25/32/ 16 <sup>°</sup> /20 <sup>°</sup> /25/32/ 16°/20 <sup>°</sup> /25/32/ 200 40/50/63/80/ 160/200/250 125 <sup>\$</sup> /160 <sup>\$</sup> /200/250/320/400				400 <sup>\$</sup> /500/630/800				U	1000																				
Release			TM(V	/TFM)		И(VTVM)/ lectronic		M(VTVM)/ TM(VTVM)/ lectronic Electronic				TN	M(VTVN	л)/Elect	ronic		Т	M(V	TVM)/Ele	ectron	nic		TM(VTVM)/Electronic				Electronic							
Poles			3P/	/4P		3P/4P		3P/4P	)		3P/4P			31	P/4P					3P/4P						3	P/4P					31	P/4P	
Impulse Withstand Voltage Uir	mp (kV)		8	8		8		8			8				8					8							8						8	
Rated Operational Voltage Ue	(V AC) (MAX) @	0 50/60Hz	41	15		500		500			690			(	690					800							800					(	590	
Rated Insulation Voltage Ui (V	′)		80	00		800		800			1000			1	000				100	00		1250			1000				1250		1000			
		220/230V AC 50/60Hz	40	50	45	50 65	45	50	65	45	65 100	150	45	65	100 15	50 200	45	65 10	00	150 200	0 -		45	65	100	150	200	-	-	-	45	65	100	150
		400/415V AC 50/60Hz	25	36	25	36 50	25	36	50	36	50 80	120	36	50	80 12	20 200	36	50 8	0	120 200	0 -		36	50	80	120	200	-	-	-	36	50	80	120
	Lass (Lan)	440V AC 50/60Hz	-	-	15	22 40	15	22	40	22	40 65	100	22	40	65 10	00 150	22	40 6	5	100 150	0 -		22	40	65	100	150	-	-	-	22	40	65	100
	Icu (kA)	500V AC 50/60Hz	-	-	8	13 18	8	13	18	18	18 20	85	18	36	55 8	5 140	18	36 5	5	85 140	0 -		18	36	55	85	140	-	-	-	18	36	55	85
		690V AC 50/60Hz	-	-	-			-	-	9	12.5 20	20	9	12.5	20 5	0 100	9	12.5 2	0.	50 100	0 -		9	12.5	20	50	100	-	-	-	9	12.5	20	20
Rated Short circuit breaking		800V AC 50/60Hz	-	-	-			-	-			-	-	-			-		-		2	5 36 50	-	-	-	-	-	25	36	50	-	-	-	-
capacity		220/230V AC 50/60Hz	100%	E0%																	_	-								-				
		400/415V AC 50/60Hz	100%	50%																		-								-				
	1	440V AC 50/60Hz	-	-		100%		100%			100%			1	00%				10	00%		-				100%				-	1	1	00%	
	Ics as % of Icu	500V AC 50/60Hz	-	-																		-								-				
		690V AC 50/60Hz	-	-																		-								30	1			
		800V AC 50/60Hz	-	-	-			-	-	-		-	-	-			-		-		2	5 30 40	-	-	-	-	-	25	30	40	-	-	-	-
Making Capacity (kA) @ 415V AC			50	75.6	50	75.6 105	50	75.6	105	75.6	105 176	264	75.6	105	176 26	54 -	75.6	105 17	76	264 440			75.6	105	176	264	440	-	-	-	75.6	105	176	264
1101710	Mechanical		300	0000 30000 20000 30000 25000									20000						2	0000					20	0000								
Life	Electrical		80								8000 4000^		2500^at 7500 630A				3000																	
	@ 415V AC		00	100		10000		10000			10000			- 10	0000				100			4000*			7500				2000^at 800A	t	3000			
Utilization Category																		Α																
Standard																IS/ EC 60	)947-2	2, IEC 6094	47-2,	, EN 6094	7-2													
Operating Frequency (Hz)																		50/60																
Fingerproof Terminals																		YES																
Insulation Class (Front Facia o	cutout region)																	Class II						_										
Suitable for isolation																ID 40		YES		1 10014														
IP Class																IP40	and IP	54 with E	xten	ded ROM														
Pollution Degree																		III															_	
Load-line bias															0.5	°0 +- 55°	0 6	NO	E°C	+0.7500.5	0 F F T	11												
Ambient temperature															-25	C 10 55°		TM and -2		10 /5°C fc	or E I	U												
Storage temperature	nlana															1/		35° C to 8		rootic														
Mounting positions in vertical	piarie	3 Pole	75*60	n*120	71	5*60*130	71	5*60*1	20		75*75*13	0		105+	90*165		icai ar	nd 90° bot		20*105*2	0.5					100+	105*25	n				100*	05*250	)
Dimensions (W*D*H) (mm)		4 Pole		0*130		0*60*130	_	0*60*1		_	100*75*13				90*165 90*165					20*105*2 60*105*2							105*250						05*250	
Weight (kg) 3P/4P		7 I UIC	0.7/			0.9/1.1		0.9/1.1			1/1.3	50			8/2.1				1 (	3.5/5	.00						9/8.9	U					9/8.9	
weight (kg) 37/47		Auxiliary Contact	0.7/			0.9/1.1 01 Aux		0.9/1.1 01 Aux			01 Aux				2 Aux					03 Aux							3 Aux						Aux	
		Trip Alarm Contact	017			01 Aux 01 TAC	_	01 TAC			01 Aux				I TAC					03 Aux 01 TAC							1 TAC						TAC	
	Internal	Shunt Release	01 Sh								UTTAC						01 TAC 02 UV or 02 Shunt or 1UV+1Shunt		+								00		02 Shur	nt or				
		Under Voltage Release	01 Sn		01 Sh	unt or 01 UV	01 Sh	unt or	01 UV	01	Shunt or 0	11 UV	(	01 Shur	nt or 01	UV				(	2 UV or	r 02 Sh	unt or 1	UV+1Sl	hunt		02		02 Snur 1Shunt					
		Rotary Operating Mechanism (DIR/EXT)		/		✓		✓			✓				✓		<b>✓</b>				✓			10V+1S										
Accessories		Mechanical Interlock Kit	,	k		✓		✓			✓				✓					✓							✓						<b>√</b>	
	External	Spreader Terminals	,	ĸ		✓		<b>√~</b>			✓				✓					✓							✓						/~	
	LATEITIAI	Rear Terminals#		ĸ		<b>√</b>		×			✓				✓					✓							✓						x	
		Box-Clamp#		/		<b>√</b>		×			✓				✓					<b>√</b>							×						x	
		Plug-in#		ĸ		<b>√</b>		×			✓				√					<b>√</b>			<b>√</b>					×						
		Draw-out#		×		×		×			✓				✓					<b>√</b>							√						x	
# Contact nearest branch offic		STATE CALIF																																

<sup>#</sup> Contact nearest branch office \$ Available only in Electronic Trip Unit ^ Only for 800V AC ~ Spreader terminals are mandatory

# **Release Features**

- > All Electronic Trip unit comply EMI & EMC as per IEC 60947-2
- > Wide range of basic & advanced protections using thermal magnetic and Electronic based releases
- > Individual LEDs for fault indication
- > Long time (overload) setting starts from 0.25 In for iTRP release and 0.67 In for thermal magnetic release
- > In-built earth fault and neutral protection
- > In-built display module for enhanced user interface
- > No need for external power supply for breaker settings and viewing trip records
- > Communicable MCCBs from 40A to 1000A
- > Available communication protocols-TCP IP, Modbus

Release Type	i TM	i TRP-1	i TRP-2	i TRP-3	i TRP-3C	i TRP-4	i TRP-5		
Protection	LI	LS/IN	LSIN	LSING	LSING + Current metering	LSING + Current metering	i TRP-4 + Advanced Metering + Advanced Protection		
Communication	-	-	-	-	Yes	Yes	Yes		
Display	-	-	-	-	-	Yes	Yes		

# **Motor Backup Protection Release**

Release	Thermal magnetic	Electronic			
Release type	Only Magnetic	i TRP-M3			
Protection	Only Instantaneous	LRISUG			

L	Protection against Overload
S	Protection against Short Circuit with intentional time delaya
I	Protection against Short Circuit without time delay
N	Protection against Neutral Overload
G	Protection against Earth Fault
R	Protection against Locked Rotor Overload
U	Protection against Current Unbalance

# **Frames & Releases at Glance**

Frames	DZ0	DZ1	DZ2	DZ4	DZ6	DZ7		
	Power Distribution							
Thermomagnetic trip units								
FTFM	16A, 20A, 25A, 32A, 40A,50A, 63A, 80A, 100A, 125A	-	-	-	-	-		
VTVM	-	16A, 20A, 25A, 32A, 40A,50A, 63A, 80A, 100A, 125A, 160A, 200A	16A, 20A, 25A, 32A, 40A,50A, 63A, 80A, 100A, 125A, 160A	160A, 200A, 250A	160A, 200A, 250A, 320A, 400A	500A, 630A, 800A		
Electronic trip units								
iTRP-1								
iTRP-2								
iTRP-3		25A*, 40A*, 63A,	40A*, 63A, 100A,		125A#, 160A#,	400A*, 500A,		
iTRP-3C	-	100A, 160A, 200A	160A	160A, 200A, 250A	200A*, 250A,	630A, 800A,		
iTRP-4					320A, 400A	1000A		
iTRP-5		-						
	l .	ı	Motor Protection					
Motor Protection - Ther	mal							
М	-	16A, 20A, 25A, 32A, 40A,50A, 63A, 80A, 100A, 125A, 160A, 200A	16A, 20A, 25A, 32A, 40A,50A, 63A, 80A, 100A, 125A, 160A	160A, 200A, 250A	250A, 320A, 400A	500A, 630A, 800A		
Motor Protection - Elec	tronic Trip Units							
iTRP-M3	-	40A, 63A, 100A, 160A, 200A	40A, 63A, 100A, 160A	160A, 200A, 250A	250A, 320A, 400A	500A, 630A, 800A		

<sup>\*</sup> Not applicable for iTRP-3C

# Thermomagnetic trip units

- › Adjustable overload setting
- › Adjustable short circuit setting\*
- > True RMS sensing





TM (iTM-AA)							
Frame	DZ0/ DZ1/ DZ2/ DZ4/ DZ6/ DZ7						
Rated Current	16A - 800A						
Protection	LI						
Over Load (Phase)							
Current Setting I <sub>r</sub> (I <sub>r</sub> = x I <sub>n</sub> )	0.67 to 1 x ln						
Instantaneous							
Current Setting $I_i$ ( $I_i = x I_n$ )	6 to 12 x I <sub>n</sub> *						

<sup>\*16</sup> A to 50 A: Fixed Magnetic 375 A

<sup>#</sup> Applicable for iTRP-1

# **Electronic Releases**

- > Wide range of overload setting starting from 0.25ln
- › Adjustable Trip class
- > Neutral overload protection
- > Short circuit setting with delay or Instantaneous option
- › Adjustable Instantaneous Setting
- > Thermal Memory with option of Defeat
- > Provision for release testing



	iTRP-1
Frame	DZ1/ DZ2/ DZ4/ DZ6/ DZ7
Rated Current (A)	25A - 1000A
Protection	LS/IN
	Over Load (Phase)
Current Setting I <sub>r</sub> (I <sub>r</sub> = x I <sub>n</sub> )	0.25 to 1 x I <sub>n</sub> (in step of 0.05)
Time delay, Tr (Inverse)	10s at 6lr, 3s at 6lr, 10s at 7.2 lr, 3s at 7.2lr
Protection Mode	ON/OFF
Thermal Memory	ON/OFF
	Over Load (Neutral)
Current Setting I <sub>N</sub> (I <sub>N</sub> = x I <sub>r</sub> )	OFF / 1.0 x l <sub>r</sub>
Time delay, T <sub>r</sub> (Inverse)	As per Overload Curve Setting
Protection Mode	ON/OFF
	Short Circuit
Current Setting I <sub>s</sub> (I <sub>s</sub> = x I <sub>r</sub> )	1.5 to 12 x I <sub>r</sub> (in step of 0.5) 25A to 500A
	1.5 to 10 x I <sub>r</sub> (in step of 0.5)630A
	1.5 to 8 x l <sub>r</sub> (in step of 0.5) 800A,1000A
Time delay, Ts	As per I <sup>2</sup> t curve /150 msec
l <sup>2</sup> t	ON/OFF
	Instantaneous
Current Setting I <sub>i</sub> (I <sub>i</sub> = x I <sub>n</sub> )	1.5 to 12 x I <sub>r</sub> (in step of 0.5) 25A to 500A
	1.5 to 10 x I <sub>r</sub> (in step of 0.5)630A
	1.5 to 8 x l <sub>r</sub> (in step of 0.5) 800A,1000A
	LED Indication
Po	wer/Release Status LED (Green)
Blinking @ 500ms (ON/OFF)	Power ON
Steady ON	Pickup
Steady OFF	Power OFF

- $\rightarrow$  Wide range of overload settings from  $0.25I_n$
- › Adjustable neutral overload protection
- > Short circuit setting with delay
- › Adjustable instantaneous setting
- > Thermal memory defeat
- > Provision for release testing
- > Individual fault indication LEDs



iTRP-2						
Frame	DZ1/ DZ2/ DZ4/ DZ6/ DZ7					
Rated Current (A)	25A - 1000A					
Protection	LSIN					
	Over Load (Phase)					
Current Setting I <sub>r</sub> (I <sub>r</sub> = x I <sub>n</sub> )	0.25 to 1 x ln (in step of 0.05)					
Time delay, Tr (Inverse)	10s at 6lr					
Protection Mode	ON/OFF					
Thermal Memory	Enable/Disable					
	Over Load (Neutral)					
Current Setting I <sub>N</sub> (I <sub>N</sub> = xI <sub>r</sub> )	OFF / 0.5/ 1.0/ 2.0 x lr					
Time delay, T <sub>r</sub> (Inverse)	As per Overload Curve Setting					
Protection Mode	ON/OFF					
Short Circuit						
Current Cetting la (L - VI)	OFF, 1.5, 3, 4.5, 5.5, 6, 7, 8.5, 10 x lr [ DZ1 to DZ6, DZ7 (500A,630A) ]					
Current Setting Is (I <sub>s</sub> = x I <sub>r</sub> )	OFF, 1.5, 3, 3.5, 5, 4.5, 6, 6.5, 8 x lr [ DZ7 (800A,1000A) ]					
Time delay, T <sub>s</sub>	100ms/200ms					
l <sup>2</sup> t	ON/OFF					
Protection Mode	ON/OFF					
	Instantaneous					
	OFF, 6, 12 x In [ DZ1 to DZ6, DZ7 (500A) ]					
Current Setting Ii $(I_i = x I_n)$	OFF, 6, 10 x In [ DZ7 (630A) ]					
	OFF, 6, 8 x In [ DZ7 (800A,1000A) ]					
Protection Mode	ON/OFF					
	LED Indication					
	Fault LED (Red)					
Steady ON [ if ① button press ]	L, S, I					
	Power/Release Status LED (Green)					
Blinking @ 500ms (ON/OFF)	Power ON					
Steady ON	Pickup					
Steady OFF	Power OFF					

- $\rightarrow$  Wide range of overload settings from  $0.25I_n$
- > Adjustable neutral overload protection
- > Short circuit setting with delay
- › Adjustable instantaneous setting
- > Thermal memory defeat
- > Provision for release testing
- > Individual fault indication LEDs
- > Inbuilt earth fault protection



	iTRP-3
Frama	DZ1/ DZ2/ DZ4/ DZ6/ DZ7
Frame	
Rated Current (A)	25A - 1000A
Protection	LSING
	Over Load (Phase)
Current Setting I <sub>r</sub> (I <sub>r</sub> = x I <sub>n</sub> )	0.25 to 1 x l <sub>n</sub> (in step of 0.05)
Time delay, t <sub>r</sub> (Inverse)	10s at 6lr
Protection Mode	ON/OFF
Thermal Memory	Enable/Disable
	Over Load (Neutral)
Current Setting $I_N(I_N = x I_r)$	OFF / 0.5/ 1.0/ 2.0 x l <sub>r</sub>
Time delay, t <sub>r</sub> (Inverse)	As per Overload Curve Setting
Protection Mode	ON/OFF
	Short Circuit
Comment Cattings I (I as I)	OFF, 1.5, 3, 4.5, 5.5, 6, 7, 8.5, 10 x lr [ DZ1 to DZ6, DZ7 (500A, 630A) ]
Current Setting $I_s$ ( $I_s = x I_r$ )	OFF, 1.5, 3, 3.5, 5, 4.5, 6, 6.5, 8 x Ir [ DZ7 (800A, 1000A) ]
Time delay, ts	100ms/200ms
l²t	ON/OFF
Protection Mode	ON/OFF
	Instantaneous
	OFF, 6, 12 x In [ DZ1 to DZ6, DZ7 (500A) ]
Current Setting $I_i$ ( $I_i = x I_n$ )	OFF, 6, 10 x In [ DZ7 (630A) ]
	OFF, 6, 8 x In [ DZ7 (800A,1000A) ]
Protection Mode	ON/OFF
	Earth Fault
Current Setting I <sub>r</sub> (I <sub>r</sub> = x I <sub>n</sub> )	0.2, 0.4, 0.5, 0.7 x ln
Time delay, Tr (Inverse)	100ms/200ms
Protection Mode	ON/OFF
	LED Indication
	Fault LED (Red)
Steady ON [ if ① button press ]	L, S, I, G
	Power/Release Status LED (Green)
Blinking @ 500ms (ON/OFF)	Power ON
Steady ON	Pickup
Steady OFF	Power OFF

# **iTRP-3C**

- > Wide range of overload setting from 0.25 In
- › Adjustable neutral overload protection
- > Short circuit setting with delay
- › Adjustable Instantaneous setting
- > In-built earth fault protection
- > Switchable Thermal memory
- > ZSI + Communication through External Module
- > Cause of Fault through Communication Module



iTRP-3C					
LSING					
Rated Current, In	50A - 1000A				
Frame	DZ1/DZ2/DZ4/DZ6/DZ7				
Overload	d (Phase)				
Current Setting Ir (I <sub>r</sub> = x I <sub>n</sub> )	0.25 to 1 x I <sub>n</sub> (in step of 0.05)				
Time delay, T <sub>r</sub> (Inverse)	10s at 6Ir				
Protection Mode	ON/ OFF				
Thermal Memory	Enable / Disable				
Overload	(Neutral)				
Current Setting I <sub>N</sub> (I <sub>N</sub> = x I <sub>r</sub> )	OFF / 0.5 / 1.0 / 2.0 x lr				
Time delay, Tr (Inverse)	As per Overload Curve Setting				
Protection Mode	ON/ OFF				
Short	Circuit				
Current Setting Is (Is= x Ir)	OFF, 1.5, 3, 4.5, 5.5, 6, 7, 8.5, 10 x lr [ DZ1 to DZ6, DZ7 (500A, 630A) ]				
Current Setting is (is- X ir)	OFF, 1.5, 3, 3.5, 5, 4.5, 6, 6.5, 8 x Ir [ DZ7 (800A, 1000A) ]				
Time delay, T <sub>s</sub>	100 ms / 200 ms				
I <sup>2</sup> T	ON/ OFF				
Protection Mode	ON/ OFF				
SC ZSI	OFF, IN, OUT, BOTH (Require ZCOM Module)				
Instant	taneous				
	OFF, 6, 12 x In [ DZ1 to DZ6, DZ7 (500A) ]				
Current Setting $I_i$ ( $I_i = x I_n$ )*	OFF, 6, 10 x In [ DZ7 (630A) ]				
	OFF, 6, 8 x In [ DZ7 (800A, 1000A) ]				
Protection Mode	ON/ OFF				
Earth	ı Fault				
Current Setting I <sub>g</sub> (I <sub>g</sub> = x I <sub>n</sub> )	0.2, 0.4, 0.5, 0.7				
Time delay, T <sub>s</sub>	100 ms / 200 ms				
Protection Mode	ON/ OFF				
EF ZSI	OFF, IN, OUT, BOTH (Require ZCOM Module)				
LED In	dication				
Power/Release S	status LED (Green)				
Blinking @ 500ms (ON/OFF)	Power ON				
Steady ON	Pickup				
Steady OFF	Power OFF				

<sup>\*</sup>Max Break Time : < 50ms for I > Ii (Trip Time Tolerance: 20% + 1 Cycle)

- > Wide range of overload setting from 0.25ln
- › Adjustable trip class
- > I2T, SI, LI-VI based over load curves
- > Neutral overload protection
- > Short circuit setting with delay
- > Adjustable Instantaneous setting
- > Thermal memory defeat
- > In-built earth fault protection
- > Advanced current based protection function
- > Trip and Event records storage capable
- > Local LCD display menu navigation using keypad
- > MODBUS RTU Communication capable

- > Provision for release testing
- > Power ON LED
- > Common fault indication and diagnostic LED
- > Self, Auxiliary and Battery power mode
- > True RMS sensing



iT	RP-4
LSING	
Rated Current	25A - 1000A
Frame	DZ1/DZ2/DZ4/DZ6/DZ7
Overlo	ad (Phase)
Current Catting In / L - v	$0.25$ to 1 x $I_n$ (in step of $0.01$ )
Current Setting Ir (Ir = x In)	0.25 to 0.5 x In (when Neutral > 100%)
Time delay, T <sub>r</sub> (Inverse) at 6l <sub>r</sub>	0.5, 1 to 16s (Step of 1)
Curve	I²T, SI, VI
Thermal memory	OFF, 10 min, 20 min
Alarm pickup	0.5-1 x lr (Step: 0.01)
Protection Mode	ON/OFF
OverLoa	nd (Neutral)
Current Setting I <sub>N</sub> (I <sub>N</sub> = x I <sub>r</sub> )	0.5, 0.75, 1, 1.6, 2 (1.6 & 2 is not allowed if Overload > 0.5)
Time delay, T <sub>r</sub> (Inverse)	O/L Curve, 0.1-1sec (Step 0.05s)
Protection Mode	ON/OFF
Alarm pickup	0.5 - 1 x I <sub>N</sub> (Step: 0.05)
Shor	t Circuit
Current Catting lad (lad - v.l.)	OFF, 1.5, 3, 4.5, 5.5, 6, 7, 8.5, 10 x Ir [ DZ1 to DZ6, DZ7 (500A, 630A) ]
Current Setting lsd (lsd = x l <sub>r</sub> )	OFF, 1.5, 3, 3.5, 5, 4.5, 6, 6.5, 8 x Ir [ DZ7 (800A, 1000A) ]
Time delay, Tsd	20, 50 to 400ms (Step 50ms)
I <sup>2</sup> T	ON/OFF
ST ZSI	OFF, IN, OUT, BOTH (Require ZSI Module)
Alarm pickup	0.5-1 x ls (Step: 0.01)
Protection Mode	ON/OFF

Current Setting I (I, = x I, I)         OFF, 6, 12 x In [DZ1 to DZ6, DZ7 (S00A)]           OFF, 6, 18 x In [DZ7 (S00A,1000A)]         OFF, 6, 18 x In [DZ7 (S00A,1000A)]           Protection Mode         ON/OFF           Current Setting I <sub>I</sub> (I <sub>0</sub> = x I <sub>0</sub> )         0.1-1 x In (Step 0.05)           Time delay, T <sub>0</sub> 50 to 500ms (Step 50ms)           FT (@1 x In)         ON/OFF           EZ SI         OFF, IIN, OUT, BOTH (Require ZSI Module)           Protection Mode         ON/OFF           Alarm pickup         0.8-1 x I <sub>1</sub> (Step: 0.05)           Under Tweetion           Pickup lupk         0.2-0.8 x Ir (Step: 0.05)           Delay         1.05-1.2 x Pickup (Step: 0.05)           Protection Mode         OFF, Alarm/Alarm & Trip           Protection Mode         OFF, Alarm/Alarm & Trip           Protection Mode         0.1-050 (Step: 5)           Protection Mode         0.1-050 (Step: 0.1)           Alarm pickup         0.1-050 (Step: 0.1)           Protection Mode         0.6-050 (Step: 0.1)           Protection Mode           Protection Mode           Protection Mode	Instantaneous Protection				
Protection Mode         OFF, 6, 8 x In [DZ7 (800A,1000A)]           Fortection Mode           Current Setting I₂ (I₂ = x I₂)         0.1-1 x I₂ (Step 0.05)           Time delay, T₂         50 to 500ms (Step 50ms)           ET Z(@]1 x In)         OW/OFF           ET ZSI         0FF, IN, OUT, BOTH (Require ZSI Module)           Protection Mode           Moder-I ** Under-I	OFF, 6, 12 x In [ DZ1 to DZ6, DZ7 (500A) ]				
Protection Mode         Both Feature With Current Setting Is (1s = x is)         1.1-1 x is (Step 0.05)           Time delay, Ts         50 to 500ms (Step 50ms)           FT (Ø) x in)         0N/OFF           FE ZSI         0FF, IN, OUT, BOTH (Require ZSI Module)           Protection Mode         0N/OFF           Alarm pickup         0.8-1 x Is (Step: 0.05)           Under-Frection           Pickup lupk         2.2-0.85 x Ir (Step: 0.05)           Belay         1.05-1.2 x Pickup (Step: 0.05)           Protection Mode           I-Unbalant & Trip           Protection Mode           1-Unbalant & Trip           Protection Mode           1-Unbalant & Trip           Protection Mode           OFF (Step 0.1)           Alarm pickup           Protection Mode           OFF (Step 0.1)           Alarm (Step 0.1)	Current Setting $I_i$ ( $I_i = x I_n$ )	OFF, 6, 10 x In [ DZ7 (630A) ]			
Earth Fult           Current Setting Is (Is = x Is)         0.1-1 x Is (Step 0.05)           Time delay, T₀         50 to 500ms (Step 50ms)           PT (@1 x Ir)         ON/OFF           EF ZSI         OFF, IN, OUT, BOTH (Require ZSI Module)           Protection Mode         0.N/OFF           Alarm pickup         0.N/OFF           Under-I = vector           Protection Mode           Pickup lupk         0.2-0.85 x Ir (Step: 0.05)           Delay         1-300 s (Step: 1)           Alarm pickup         0.5-1.2 x Pickup (Step: 0.05)           Protection Mode           I-Unbalarm & Trip           Delay         0.1-60s (Step: 0.1)           Alarm pickup         0.1-60s (Step: 0.1)           Delay         0.1-60s (Step: 0.1)           Alarm pickup         0.0 (Step: 0.1)           Protection Mode         0.0 (Step: 0.1)           Other Full           Other Jerustrus           Alarm Alarm & Trip           Other Jerustrus           Alarm (80°)           Alarm (80°)         Alarm (80°)           Alarm & Trip (105)         Alarm & Trip (105)           Delay & Ala		OFF, 6, 8 x In [ DZ7 (800A,1000A) ]			
Current Setting Is (Is = x Is)         0.11 x Is (Step 0.05)           Time delay, T₂         50 to 500ms (Step 50ms)           PT (@1 x In)         ON/OFF           EF ZSI         OFF, IN, OUT, BOTH (Require ZSI Module)           Protection Mode         ON/OFF           Alarm pickup         0.81 x Is (Step: 0.05)           Under - Protection           Pickup lupk         0.2-0.85 x Ir (Step: 0.05)           Delay         1.300 s (Step: 1)           Alarm pickup         1.50-1.2 x Pickup (Step: 0.05)           Protection Mode           OFF/Alarm/Alarm & Trip           Delay           Delay         0.1-60s (Step 0.1)           Alarm pickup         80% of Pickup           Protection Mode         OFF/Alarm/Alarm & Trip           Other Protection           Mode           Other Protection           Mode           Alarm (80°)           Alarm (80°)         Alarm (80°)           Alarm 80°)         Alarm 80°)           Alarm 80°)         Alarm 80°)           Alarm 80°)         Alarm 80°)           Alarm 80°)         Alarm 80°)           Alarm 80°)         Alarm 80°) <td>Protection Mode</td> <td>ON/OFF</td>	Protection Mode	ON/OFF			
Time delay, T₀         50 to 500ms (Step 50ms)           PT (@1 x in)         0N/OFF           EF ZSI         OFF, IN, OUT, BOTH (Require ZSI Module)           Protection Mode         0N/OFF           Alarm pickup         0.8-1 x I₀ (Step: 0.05)           Under-I vection           Pickup lupk         0.2-0.85 x Ir (Step: 0.05)           Delay         1.300 s (Step: 1)           Alarm pickup         0.9F/Alarm/Alarm & Trip           Protection Mode           Protection Mode           Protection Mode           Off-Polarm/Alarm & Trip           Protection Mode           Off-Polarm/Alarm & Trip           Protection Mode           Off-Polarm/Alarm & Trip           Off-Polarm/Alarm & Trip           Off-Polarm/Alarm & Trip           Off-Polarm/Alarm & Trip           Alarm & Trip (105)	Earth	Fault			
PT (@1 x in)	Current Setting I <sub>g</sub> (I <sub>g</sub> = x I <sub>n</sub> )	0.1-1 x l <sub>n</sub> (Step 0.05)			
EF ZSI         OFF, IN, OUT, BOTH (Require ZSI Module)           Protection Mode         ON/OFF           Alarm pickup         0.8-1 x I₂ (Step: 0.05)           Under J Deckup lupk           Pickup lupk         0.2-0.85 x Ir (Step: 0.05)           Delay         1-300 s (Step: 1)           Alarm pickup         1.05-1.2 x Pickup (Step: 0.05)           Protection Mode           I-Unbalare Protection           Pickup           Delay         10-90% (Step: 5)           Delay         0.1-60s (Step 0.1)           Alarm pickup         0FF/Alarm/Alarm & Trip           Protection Mode         OFF/Alarm/Alarm & Trip           OFF Protection Mode           Alarm (Bo')	Time delay, T <sub>9</sub>	50 to 500ms (Step 50ms)			
Protection Mode         ON/OFF           Alarm pickup         0.8·1 x 1 <sub>8</sub> (Step: 0.05)           Under-I vection           Pickup lupk         0.2·0.85 x Ir (Step: 0.05)           Delay         1-300 s (Step: 1)           Alarm pickup         0.5-1.2 x Pickup (Step: 0.05)           Protection Mode           I-Unbalance Protection           Protection Mode           Delay           Delay         0.1-60 (Step: 0.1)           Alarm pickup         0.9° (Step: 5)           Other Vection           Protection Mode           OFF Alarm/Alarm & Trip           OFF Alarm (80°)           Alarm (80°)           Alarm (80°)           Alarm & Trip (105)           Tel Distriction           Release Stet Distriction           Blinking @ 100ms (0N/OFF)         Trip Mode           Blinking @ 500ms (0N/OFF)         Alarm Mode           Steady Of         Pickup Mode           Steady Off         No fault           Power LEU (Green)	I <sup>2</sup> T (@1 x in)	ON/OFF			
Alarm pickup         0.8:1 x 1 <sub>9</sub> (Step: 0.05)           Pickup lupk         0.2:0.85 x Ir (Step: 0.05)           Delay         1.300 s (Step: 1)           Alarm pickup         0.5F/Alarm/Alarm & Trip           Protection Mode         0FF/Alarm/Alarm & Trip           Pickup           Delay         0.1-60 (Step 0.1)           Alarm pickup         0.7F/Alarm/Alarm & Trip           Protection Mode         OFF/Alarm/Alarm & Trip           Mode         OFF           Marm (80°)         Alarm (80°)         Alarm (80°)         Alarm (80°)         Alarm & Trip (105)         ELED ING         Blinking @ 100ms (0N/OFF)         Alarm Mode         Steady On         Alarm Mode         Steady On         Pickup Mode         No fault           Power LEU (Green)         Power LEU (Green	EF ZSI	OFF, IN, OUT, BOTH (Require ZSI Module)			
Under-I Protection           Pickup lupk         0.2-0.85 x lr (Step: 0.05)           Delay         1-300 s (Step: 1)           Alarm pickup         1.05-1.2 x Pickup (Step: 0.05)           Protection Mode         OFF/Alarm/Alarm & Trip           I-Unbalance Protection           Pickup         10-90% (Step: 5)           Delay         0.1-60s (Step 0.1)           Alarm pickup         8% of Pickup           Protection Mode         0FF/Alarm/Alarm & Trip           Other Description           Mode           Mode           Alarm (80°)           Alarm (80°)           Alarm (80°)           Alarm & Trip (105)           LED Internal Test LED (Red)           Blinking @ 100ms (ON/OFF)         Trip Mode           Blinking @ 500ms (ON/OFF)         Alarm Mode           Steady On         Pickup Mode           Steady Off         No fault	Protection Mode	ON/OFF			
Pickup lupk         0.2 0.85 x lr (Step: 0.05)           Delay         1-300 s (Step: 1)           Alarm pickup         1.05-1.2 x Pickup (Step: 0.05)           Protection Mode         0FF/Alarm/Alarm & Trip           I-Unbalanter Protection           I-Unbalanter Protection           Delay         0.1-60s (Step 0.1)           Alarm pickup         0FF/Alarm/Alarm & Trip           Other Pretection           Internal Termeature           Mode           Mode           Alarm (80°)           Alarm (80°)           Alarm & Trip (105)           LED Internal Term & Trip Mode           Blinking @ 100ms (0N/OFF)         Alarm Mode           Blinking @ 500ms (0N/OFF)         Alarm Mode           Steady On         Pickup Mode           Steady Off         No fault	Alarm pickup	0.8-1 x l <sub>g</sub> (Step: 0.05)			
Delay         1-300 s (Step: 1)           Alarm pickup         1.05-1.2 x Pickup (Step: 0.05)           Protection Mode           I-Unblastre           Protection           Pickup         10-90% (Step: 5)           Delay         0.1-60s (Step 0.1)           Alarm pickup           Protection Mode           OFF/Alarm/Alarm & Trip           Internal Trip           Mode           Alarm (80°)           Alarm (80°)           Alarm (80°)           Alarm 8 Trip (105)           LED Internal Trip (105)           Elinking @ 100ms (0N/OFF)         Trip Mode           Blinking @ 500ms (0N/OFF)         Alarm Mode           Steady On         Pickup Mode           Steady Off         No fault	Under-I F	Protection			
Alarm pickup         1.05-1.2 x Pickup (Step: 0.05)           Protection Mode           Frotection Mode           Frotection Mode           Delay         0.1-60s (Step 0.1)           Alarm pickup           Other > Trip           Other > Trip           Other > Trip           Mode           Alarm (80°)           Alarm (80°)           Alarm & Trip (105)           LED Interior           Release State LED (Red)           Blinking @ 100ms (0N/0FF)         Trip Mode           Blinking @ 500ms (0N/0FF)         Alarm Mode           Steady On         Pickup Mode           Steady Off           Power LED (Green)	Pickup lupk	0.2-0.85 x lr (Step: 0.05)			
Protection Mode         OFF/Alarm/Alarm & Trip           Protection           Protection           Delay         0.1-60s (Step 0.1)           Alarm pickup         80% of Pickup           Protection Mode         OFF/Alarm/Alarm & Trip           OFF           Alarm (80°)           Alarm (80°)           Alarm & Trip (105)           LED Index           Release Statis LED (Red)           Blinking @ 100ms (0N/0FF)         Trip Mode           Blinking @ 500ms (0N/0FF)         Alarm Mode           Steady On         Pickup Mode           Steady Off         No fault           Power LED (Green)	Delay	1-300 s (Step: 1)			
I-Unbalance Protection           Pickup         10-90% (Step: 5)           Delay         0.1-60s (Step 0.1)           Alarm pickup           OFF/Alarm/Alarm & Trip           Other Protection           Internal Temperature           Mode           Alarm (80°)           Alarm & Trip (105)           LED India & Trip (105)           Release Statu LED (Red)           Blinking @ 100ms (0N/OFF)         Trip Mode           Blinking @ 500ms (0N/OFF)         Alarm Mode           Steady On         Pickup Mode           Steady Off         No fault           Power LED (Green)	Alarm pickup	1.05-1.2 x Pickup (Step: 0.05)			
Pickup         10-90% (Step: 5)           Delay         0.1-60s (Step 0.1)           Alarm pickup         80% of Pickup           OFF/Alarm/Alarm & Trip           Internal Terreture           Mode           Alarm (80°)           Alarm (80°)           Alarm & Trip (105)           EED Internal Terp (105)           Blinking @ 100ms (ON/OFF)         Trip Mode           Blinking @ 500ms (ON/OFF)         Alarm Mode           Steady On         Pickup Mode           Steady Off         No fault           Power LEU (Green)	Protection Mode	OFF/Alarm/Alarm & Trip			
Delay         0.1-60s (Step 0.1)           Alarm pickup         80% of Pickup           Protection Mode         OFF/Alarm/Alarm & Trip           Mode         Internal Temperature           Mode         Alarm (80°)           Alarm & Trip (105)           EED Intoit           Release Status LED (Red)           Blinking @ 100ms (ON/OFF)         Trip Mode           Blinking @ 500ms (ON/OFF)         Alarm Mode           Steady On         Pickup Mode           Steady Off         No fault           Power LEU (Green)	I-Unbalanc	e Protection			
Alarm pickup         80% of Pickup           Protection Mode           Other Protection           Internal Temperature           Mode           Mode         Alarm (80°)           Alarm & Trip (105)           LED Indication           Release Status LED (Red)           Blinking @ 100ms (0N/0FF)         Trip Mode           Blinking @ 500ms (0N/0FF)         Alarm Mode           Steady On         Pickup Mode           Steady Off         No fault           Power LED (Green)	Pickup	10-90% (Step: 5)			
Protection Mode         OFF/Alarm/Alarm & Trip           Other Protection           Internal Temperature           Mode           Alarm (80°)           Alarm & Trip (105)           LED Indication           Release Status LED (Red)           Blinking @ 100ms (0N/0FF)         Trip Mode           Blinking @ 500ms (0N/0FF)         Alarm Mode           Steady On         Pickup Mode           Steady Off         No fault           Power LED (Green)	Delay	0.1-60s (Step 0.1)			
Other Protection           Internal Temperature           Mode         OFF           Alarm (80°)         Alarm & Trip (105)           LED Indication           Release Status LED (Red)           Blinking @ 100ms (0N/0FF)         Trip Mode           Blinking @ 500ms (0N/0FF)         Alarm Mode           Steady On         Pickup Mode           Steady Off         No fault           Power LED (Green)	Alarm pickup	80% of Pickup			
Internal Temperature       Mode     OFF       Alarm (80°)     Alarm & Trip (105)       LED Indication       Release Status LED (Red)       Blinking @ 100ms (0N/0FF)     Trip Mode       Blinking @ 500ms (0N/0FF)     Alarm Mode       Steady On     Pickup Mode       Steady Off     No fault       Power LED (Green)	Protection Mode	OFF/Alarm/Alarm & Trip			
Mode         OFF           Alarm (80°)         Alarm & Trip (105)           LED Indication           Release Status LED (Red)           Blinking @ 100ms (ON/OFF)         Trip Mode           Blinking @ 500ms (ON/OFF)         Alarm Mode           Steady On         Pickup Mode           Steady Off         No fault           Power LED (Green)	Other P	rotection			
Alarm (80°)           Alarm (80°)           Alarm & Trip (105)           EED Indication           Release Status LED (Red)           Blinking @ 100ms (0N/0FF)         Trip Mode           Blinking @ 500ms (0N/0FF)         Alarm Mode           Steady On         Pickup Mode           Steady Off         No fault           Power LED (Green)	Internal Te	emperature			
Alarm & Trip (105)  LED Indication  Release Status LED (Red)  Blinking @ 100ms (ON/OFF) Trip Mode  Blinking @ 500ms (ON/OFF) Alarm Mode  Steady On Pickup Mode  Steady Off No fault  Power LED (Green)		OFF			
LED Indication  Release Status LED (Red)  Blinking @ 100ms (ON/OFF) Trip Mode Blinking @ 500ms (ON/OFF) Alarm Mode Steady On Pickup Mode Steady Off No fault  Power LED (Green)	Mode	Alarm (80°)			
Release Status LED (Red)  Blinking @ 100ms (ON/OFF) Trip Mode  Blinking @ 500ms (ON/OFF) Alarm Mode  Steady On Pickup Mode  Steady Off No fault  Power LED (Green)		Alarm & Trip (105)			
Blinking @ 100ms (ON/OFF)  Blinking @ 500ms (ON/OFF)  Alarm Mode  Steady On  Pickup Mode  Steady Off  No fault  Power LED (Green)	LED Inc	dication			
Blinking @ 500ms (ON/OFF)  Alarm Mode  Steady On  Pickup Mode  Steady Off  No fault  Power LED (Green)					
Steady On Pickup Mode Steady Off No fault Power LED (Green)	, , ,	·			
Steady Off No fault Power LED (Green)					
Power LED (Green)	· · ·	•			
	-	I.			
Blinking @ 500ms (ON/OFF) Power ON					

- > Wide range of overload setting from 0.25In
- › Adjustable trip class
- > I2T, SI, LI-VI based over load curves
- > Neutral overload protection
- > Short circuit setting with delay
- > Adjustable Instantaneous setting
- > Thermal memory defeat
- > In-built earth fault protection
- > Advanced current and voltage based protection function
- > Trip and Event records storage capable
- > Local LCD display menu navigation using keypad
- > Comprehensive current, voltage, power and energy metering
- > MODBUS RTU Communication capable
- > Provision for release testing
- > Power ON LED

- > Common fault indication and diagnostic LED
- > Self, Auxiliary and Battery power mode
- > True RMS sensing



iTRP-5				
LSING				
Rated Current	25A - 1000A			
Frame	DZ1/DZ2/DZ4/DZ6/DZ7			
(OverLoad (Phase), Overload (Neutral	), Short Circuit, Instantaneous Protection, Earth Fault, Under-I Protection, I-Unbalance Protection, Internal Temperature Protections refer iTRP-4.)			
	Voltage Protection			
	Under-V Protection			
	0: OFF			
Mode	1: Pickup Alarm			
	2. Alarm & Trip			
Pickup	0.4-0.95 x Un (Step 0.01)			
Delay	0.1-60s (Step 0.1s)			
	Over-V Protection			
	0: OFF			
Mode	1: Pickup Alarm			
	2: Alarm & Trip			
Pickup	1.05-1.5 x Un (Step 0.01)			
Delay	0.1-60s (Step 0.1s)			
	V-Unbalance Protection			
	0: OFF			
Mode	1: Pickup Alarm			
	2: Alarm & Trip			
Pickup	5-25% (Step: 1)			
Delay	0.5-60s (Step 0.5s)			
Residual Protection				
	0: OFF			
Mode	1: Pickup Alarm			
	2: Alarm & Trip			
Pickup	5-40v (Step 5v)			
Delay	0.5-60s (Step 0.5s)			

Frequency Protection						
Under-freq Protection						
	0: OFF					
Mode	1: Pickup Alarm					
	2: Alarm & Trip					
Pickup	50: 45 to 49.9, 60: 54 to 59.9 (Step 0.1 Hz)					
Delay	0.1-30s (Step 0.1)					
	Protection					
	0. OFF					
Mode	1: Pickup Alarm					
	2: Alarm & Trip					
Pickup	50: 50.1 to 55, 60: 60.1 to 66 (Step 0.1 Hz)					
Delay	0.1-30s (Steps: 0.1)					
	rotection					
Rev Power	Protection					
	0: OFF					
Mode	1: Pickup Alarm					
	2: Alarm & Trip					
Pickup	0.05 To 0.40 Pn (steps 0.01Pn)					
Delay	0.5 To 60 s (steps 0.5s)					
-	Protection					
	0: OFF					
Mode	1: Pre-trip/Pickup Alarm					
	2: Alarm & Trip					
Pickup	0.50 To 0.99 Pf (steps 0.01Pf)					
Delay	100 To 500ms (steps 50ms)					
-	ctor Protection					
	0: OFF					
Mode	1: Pre-trip/Pickup Alarm					
	2: Alarm & Trip					
Pickup	0.50 To0.99 Pf (steps 0.01Pf)					
Delay	100 To 500ms (steps 50ms)					
MD Active Protection						
	0: OFF					
Mode	1. Pickup Alarm					
	2: Alarm & Trip					
	0: Deliver					
Pickup	1: Receive					
Delay	0.4 to 1 (steps 0.01) (Rated Power)					
	e Protection					
	0: OFF					
Mode	1: Pretrip/Pickup Alarm					
	2: Alarm & Trip					
	0: Deliver					
Pickup	1: Receive					
Delay	0.4 to 1 (steps 0.01) (Rated Power)					
-	nt Protection					
ии Аррагег	0: OFF					
Mode	1: Pickup Alarm					
INIOUC	2: Alarm & Trip					
Diokup						
Pickup	0.4 to 1 (steps 0.01) (Rated Power)					

Other Protection				
Ph Sequence Protection				
0. OFF				
Mode	1: Pickup Alarm			
	2: Alarm & Trip			
Pickup	0.1s To 5 s (steps 0.1s)			
THD I Pr	rotection			
	0: OFF			
Mode	1: Pickup Alarm			
	2: Alarm & Trip			
Pickup	5 To50% (steps 1)			
Delay	5 To 15s (steps 1s)			
THD V Protection				
	0: OFF			
Mode	1: Pickup Alarm			
	2: Alarm & Trip			
Pickup	5 To 50% (steps 1)			
Delay	5s To 15s (steps 1s)			
Interna	l Temp			
	0: OFF			
Mode	1: Alarm (80 degree)			
	2: Alarm & Trip (105 degree) (30 secs delay)			
LED Indication				
	tus LED (Red)			
Blinking @ 100ms (ON/OFF)	Trip Mode			
Blinking @ 500ms (ON/OFF)	Alarm Mode			
Steady On	Pickup Mode			
Steady Off	No fault			
Power LE	D (Green)			
Blinking @ 500ms (ON/OFF)	Power ON			

All electronic releases provide in-built Instantaneous-Override protection fixed @ 1.2 to 1.3 x li maximum setting.

- Wide range of overload setting from 0.25ln
- > Adjustable trip class 10, 20, 30
- > Lock Rotor protection with adjustable delay
- > Short circuit protection with no delay
- > Instantaneous protection with fixed threshold
- > In-built earth fault protection
- > Integrated contactor control relay
- > Provision for release testing
- > Separate LED for every fault indication



i TRP-M3						
LRISUG						
Rated Current	25A - 1000A					
Frame	DZ1/DZ2/DZ4/DZ6/DZ7					
Ove	r Load					
Current Setting Ir (Ir = x In)	0.25 to 1 x In (in step of 0.05)					
Trip Class	10, 20, 30 @ 7.2lr (Startup Time 7s, 14s, 21s respectively)					
Trip Class	TM (< 20 mins)					
TM (< 20 mins)	Always Active					
Protection Mode	ON/OFF					
Loci	Rotor					
Current Catting in (II D - v In)	3, 5, 6, 8 x lr (Threshold - Avg of 3phases)					
Current Setting in (ILR = x Ir)	3, 5, 6, 8 x ln (when O/L is OFF)					
Time delay, tLR (seconds)	0.5, 1, 2, 3s (Active after Startup time as selected in Overload)					
Protection Mode	ON/OFF					
Instar	ataneous					
Current Setting li(li=x ln)	12 x In [ DZ1 to DZ6, DZ7 (500A, 630A) ]					
outent setting n(n-x m)	10 x In [ DZ7 (800A,1000A) ]					
Delay Max 40ms						
Short Circuit						
Current Setting Is (Is = x Ir)	OFF, 5, 7, 8, 10 x Ir [DZ1 to DZ6, DZ7(500A, 630A)]					
	OFF, 5, 6, 7, 8 x Ir [DZ7(800A, 1000A)]					
Delay	<60ms					
Protection Mode	ON/OFF					
Unb	alance					
Current Setting lunbal	30% of l <sub>avg</sub>					
Time delay, tlunbal (seconds)	0.7sec at startup, 4sec in steady state					
Protection Mode ON/OFF						
Eart	h Fault					
Current Setting Ig (Ig = In)	0.1, 0.2, 0.4, 0.5 x ln					
	100ms/200ms					
Time delay, Ts	1001115/2001115					

LED Indication				
LED (GREEN) - 1 No				
Power	Blinking for power indication with rate as follows:			
	- one second (0.5S ON & 0.5S OFF) - If Inst Override is On			
	- four second (2S ON & 2S OFF) - If Inst Override is Off.			
Fault	Steady above pickup for Overload and STS			
LED (Red) - 6 No				
Fault Indication- R	Steady Glow after pressing Switch SW1, once the breaker			
Fault Indication- SC	has tripped. LED glow, in aux power, determines the Fault			
Fault Indication- Unbalance	in which the breaker has tripped. Auto clear once the			
Fault Indication- INST	breaker closes and current flows or Query pressed for			
Fault Indication- EF	more than 10sec			
LED	ndication			
	Relay picks up 400ms before the fault initiation command.			
Overload/Phase Unbalance / Locked Rotor	Reset time for relay is 3min.			
	Relay is rated for 0.5A, 230V ac.			

# **Accessories**

Accessories	DZ0	DZ1	DZ2	DZ4	DZ6	DZ7
Internal Accessories						
Auxiliary Contact Trip Alarm Contact	<b>√</b>	<b>√</b>	<b>√</b>	✓	✓	<b>√</b>
Shunt Release AC	✓	✓	✓	✓	✓	✓
Shunt Release DC	✓	✓	✓	✓	✓	✓
Under Voltage Release AC	✓	✓	✓	✓	✓	✓
Under Voltage Release DC	✓	✓	✓	✓	✓	✓
External Accessories						
Rotary Operating Mechanism - Direct	✓	✓	✓	✓	✓	✓
Rotary Operating Mechanism - Extended	✓	✓	✓	✓	✓	✓
Keylocks	✓	✓	✓	✓	✓	✓
Plug-in Module	×	✓	✓	✓	✓	✓
Draw Out Module	*	*	*	✓	✓	✓
Electrical Operating Mechanism	×	✓	✓	✓	✓	✓
Phase Barrier	✓	✓	✓	✓	✓	✓
Mechanical Interlock Kit						
Front Slider	×	✓	✓	✓	×	×
Cable Base Plate Type	×	✓	✓	✓	✓	×
Rear Base Plate MIL	×	×	×	✓	✓	✓
Terminations						
Terminals with Spreaders	✓	✓	✓	✓	✓	✓
Terminals with Rear Terminals	×	✓	✓	✓	✓	✓
Terminals with Box Clamps	✓	✓	✓	✓	✓	×
Short Terminal shroud	✓	✓	✓	✓	✓	✓
Long Terminal shroud	✓	✓	✓	✓	✓	✓
Modules for iTRP-3C / iTRP-4 / iTRP-5						
Communication Module	×	✓	✓	✓	✓	✓
Zone Selective Interlocking Module	×	✓	✓	✓	✓	✓
Z-COM Module ( ZSI+COM)	*	✓	✓	✓	✓	✓
Temperature Module	×	✓	✓	✓	✓	✓
Programmable Relay Module	*	✓	✓	✓	✓	✓
External Neutral CTs	×	✓	✓	✓	✓	✓
Electronic Test Kit	*	✓	✓	✓	✓	✓

# **Internal Accessories**

**Auxiliary Contact** 

Trip Alarm Contact

Shunt / Under Voltage Release

DZ MCCBs offers wide range of snap fit accessories. There are up to 6 cavities for variety of accessories, this allow customers to use all possible combinations and provide maximum flexibility.

There is no need to open main cover and no live parts are accessed, during installation.









DZ1/DZ2

4 DZ6/DZ7

Internal Accessory	Contacts / Supply Voltage	МССВ	Cavity (Right / Left)
		DZ0	Right
		DZ1	Left
Auxiliary Contact	1 C/O	DZ2	Left
Auxiliary Contact	1 6/0	DZ4	Left
		DZ6	Left
		DZ7	Left
		DZ0	Right
		DZ1	Left
Trin Alarma Cantast	1.0/0	DZ2	Left
Trip Alarm Contact	1 C/O	DZ4	Right
		DZ6	Left
		DZ7	Left
	12V DC 24V DC 48V DC 110V DC 220V DC 24V AC 48V AC 110V AC 240V AC 415V AC	DZ0	Left
		DZ1	Right
		DZ2	Right
Shunt Release		DZ4	Right
		DZ6	Right
		DZ7	Right
	12V DC	DZ0	Left
	24V DC 48V DC	DZ1	Right
	110V DC 220V DC	DZ2	Right
Under Voltage Release	24V AC	DZ4	Right
	48V AC 110V AC	DZ6	Right
	240V AC 415V AC	DZ7	Right

# **Auxiliary Contacts & Trip Alarm Contacts**

DZ MCCB range comes with two sizes of changeover contacts covering the entire range from 16 A to 1000 A. These contacts enable remote monitoring of MCCB status, including ON, OFF, and Trip. They are suitable for indications, electrical locking, relaying, and more.

## Salient Feature:

- > Offered in 3 sizes encompassing the entire 16 A to 1000 A range
- > Sturdy installation, mountable using snap-fits and easily removable.
- > 100% of the MCCB's rated mechanical endurance
- Choice of 2-Aux contacts from 16 A to 160 A, & 3-Aux contacts from 250 A to 1000 A
- > Identical changeover switches for both Aux and TAC applications



# **Specifications**

Product		Auxiliary Contact / Trip Alarm Contact			
Versions	Size 0		Size 1		Size 2
Supply type	AC	AC	DC	AC	DC
Compatible frames	DZ0		DZ1, DZ2, DZ4		DZ6, DZ7
Rated operating voltage, Un (V)	240	240	220, 110, 60, 24, 12	240	220, 110, 60, 24, 12
Rated operational current In (A)	6	6	0.25, 0.5, 1, 5, 6	6	0.25, 0.5, 1, 5, 6
Utilization category	AC 14	AC 14	DC 12	AC 14	DC 12
Mounting	Screw Snap fit				
Rated frequency (Hz)		50/60			
Rated Duty		Continuous			
Standard	IEC 60947-5				
Termination	Pre wired (0.5 mm²) 500mm length				
Electrical life	100% of MCCB Mechanical life				
Mechanical life	100% of MCCB Mechanical life				

## **Shunt Release**

The Shunt release enables tripping or cutting off the supply at the MCCB through an electrical remote command. If the operational voltage falls within a range of 70% to 110% of its rated operational voltage, the shunt release will trip the MCCB. It mechanically locks the main mechanism of the MCCB, making it impossible to switch ON the MCCB until control voltage is applied. This feature prevents closing the MCCB with the shunt release energized. There is no tripping memory

when the MCCB is in the OFF condition. If the MCCB is in the OFF condition and the shunt release receives a tripping signal in the form of rated voltage during maintenance, the next ON operation will not trip; the MCCB will be switched ON. When inserting an energized shunt release in the MCCB, if the MCCB is switched ON or in the closed condition, the Shunt facilitates tripping of the main mechanism to open the MCCB before full insertion.

#### **Key Feature:**

- > Shunt release coils are continuously rated coils
- > Low burden on the control circuit system due to low VA
- > Finger-proof termination with IP20 protection
- > Offered in only 3 sizes covering the entire range of 16 A to 1000 A
- > Sturdy fitment and mounting using screws
- > Endurance: 100% of the MCCB's rated mechanical endurance
- > Options of 2-UV or 2-Shunt or 1-UV and 1-Shunt from 250 A onwards till 1000 A



Product	SHUNT RELEASE			
Versions	Size 0	Size 1	Size 2	
Supply type	AC	AC/DC	AC/DC	
Compatible frames	DZ0	DZ1, DZ2, DZ4	DZ6, DZ7	
Rated operating voltage, un (V)	110, 240, 415 DC - 12, 24, 48, 110, 240, 415			
Mounting	Screw Snap fit & Screw			
Rated frequency (Hz)	50/60			
Response Time (ms)	25			
Standard	IEC 60947-2			
Operating range,				
Rated duty	Short Rated, Continuous at 240 Continuous			
Shunt trip	(0.7 to 1.1) Un			
Connection	Pre-wired (0.5 mm²)			
Endurance	30% of breaker mechanical endurance			

Shunt Release					
Power Consumption in short time (VA)			(VA)		
Voltage 50/60 Hz	DZ0 (Size 0) DZ1/ DZ2/ DZ4 (Size 1) DZ6/DZ7 (Size 2)				
415 AC	5	5	5		
240 AC	5	5	5		
110 AC	5	5	5		
48 AC	5	5	5		
24 AC	5	5	5		

# **Under Voltage Release**

The Under Voltage release facilitates tripping or cut-off of supply instantaneously, if the operational voltage falls to a value between 35% to 70% of its rated operational voltages.

Under-voltage release mechanically locked the main mechanism of MCCB and makes it impossible to switching ON the MCCB until it is no voltage or under voltage in control circuit. This is facilitating through feature which do not allow to close the MCCB with under-voltage release de-energised.

There is no tripping memory in OFF condition of MCCB. If MCCB is in OFF condition and under-voltage release got tripping signal in form of under voltage during maintenance, then next ON operation will not be tripped, MCCB will get switched ON.

While inserting de-energised under-voltage release in MCCB, if MCCB is switched ON or in close condition then UV facilitate tripping of main mechanism to open the MCCB before full insertion.

#### Salient features

- > Under-voltage coils are continuously rated coils
- > Low burden on the control circuit system due to low VA
- > Finger-proof termination with IP20 protection
- > Offered in only 3 sizes covering the entire range of 16 A to 800 A
- > Sturdy fitment and mounting using screws
- > Endurance: 100% of the MCCB's rated mechanical endurance
- > Options of 2-UV or 2-Shunt or 1-UV and 1-Shunt from 250 A onwards till 800 A



# **Specifications**

Product	Under Voltage release			
Versions	Size 0	Size 1	Size 2	
Supply type	AC	AC	AC	
Compatible frames	Frame 0	Frame 1, 2, 3 & 4	Frame 5, 6, 7	
Rated operating voltage, un (V)	110, 240, 415	24, 48, 1	10, 240, 415	
Mounting	Scre	W	Snap fit & Screw	
Rated frequency (Hz)	50/60			
Response Time (ms)	25			
Standard	IEC 60947-2			
Operating range,				
UV pick up	(0.85 to 1.1) Un			
UV drop off	(0.35 to 0.7) Un			
Rated duty	Continuous			
Connection	Pre-wired (0.5 mm²)			
Endurance	30% of breaker mechanical endurance			
Mounting	Screw Snap fit & Screw			

Under Voltage Release						
Voltage 50/60 Hz	Power Consumption in short time (VA)					
	DZ0 (Size 0)	DZ1/ DZ2/ DZ4 (Size 1)	DZ6/DZ7 (Size 2)			
415 AC	5	5	5			
240 AC	5	5	5			
110 AC	5	5	5			
48 AC	5	5	5			
24 AC	5	5	5			

# **External Accessories**

# **Rotary Operating Mechanism (ROM)**

Rotary Operating Mechanism (ROM) used in dsine DZ is available in two variations: Direct and Extended versions.

**Direct ROM:** The ROM is directly attached to the operating mechanism of the MCCB and is used to manually operate the breaker.

**Extended ROM:** The ROM is equipped with extensions or additional components, possibly for specific applications or installations where a longer reach or different operational setup is required.

#### Salient features


- > Clear indication for ON/OFF/TRIP status
- > Direct access to the "Push to Trip" button
- > Suitable for use in any quadrant
- > Door interlock feature when in ON mode, with option to override
- > Door interlock feature when in OFF mode, with padlock capability
- > Supports three padlocks with diameters ranging from 5mm to 8mm
- Door sensing functionality
- Mechanical interlock compatibility with various keylock types such as Ronis, Kirk, Allen-Bradley, Fortress, Castle, etc.
- Ingress Protection (IP) ratings of IP42 and IP54 for the direct and extended versions respectively





# **Key Lock**

For mechanical interlocking through extended rotary operating mechanism, a panel mounted key lock is available. The selection of the key lock as per the table:

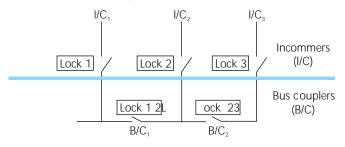



## **Selection**

I/C or B/C	Key Lock
2 I/C	Any 1 type of lock for both MCCBs
2 I/C and 1 B/C	Lock 1 and Lock 2 for I/C and Lock 12 for B/C
3 I/C and 2 B/C	Locks 1, 2, 3 for I/Cs and Locks 12, 23 for B/Cs

Type of lock	Exclusively operable by key nos.
1	1
2	2
3	3
12	1, 2 & 12
23	2, 3 & 23

# **Plug-in Module**

MCCBs with "Plug-in" module is used in applications which demand higher levels of service continuity and a fast replacement.

In case of a fault in an electrical system, MCCB clears the faults efficiently and effectively. In sites requiring higher level of

service continuity such as Hospitals and powerplants, the site demands replacement of MCCB immediately. In such cases, MCCB with plug-in base can be safely removed from the system without removing the power connections or terminations and can be replaced with the new MCCB.

Once MCCB is removed from the plug-in base, the system also offers complete isolation from the supply and hence, it enhances the safety of personnel working on down-stream feeders.

#### Salient features

- Inbuilt safety interlock a mechanism which prevents plug in/out of the MCCB when the MCCB is in ON condition to prevent connecting or disconnecting the power circuits under load conditions.
- Suitable for different types of terminations i.e., Front terminations, Spreader links, Box Clamps and Rear terminations in line with MCCB terminations.
- True indication of the status of MCCB through potential free auxiliary switch - in service position.

## **Constructional details**

# The new dsine DZ MCCB Plug-in module consist of following accessory kits:

- > Plug-in base, with terminations, is the fixed part and can be panel mounted
- Conversion kit, consisting of moving parts, which is mounted on the MCCB.

Plug-in base is an insulated thermoset component, which has provisions to accommodate socket assemblies, auxiliary switch assembly, IP covers, finger shields, terminals, mounting plates, and shields. It also includes a slot for MIL (Mechanical interlock) actuation. DZ7 Plug-in has side plate assemblies having position lock mechanism and driving mechanism.

Finger shield and IP covers are inserted in the Plug-in base at the respective positions of all phases to ensure Ingress Protection (IP). The plug-in base also has provision to accommodate all types of termination like Front terminations, Spreader links, Box Clamp and Rear terminations in line with the MCCB.

Conversion kit contains a rear plate assembly which has safety lock mechanism. Rear plate is fastened to the rear side of MCCB by two screws (4 screws in case of DZ7 Plug-in). Safety lock mechanism is used for arresting the movement of MCCB to or from the connected position when the breaker is in ON condition.





- DZ7 Plug-in comes with a driving mechanism for ergonomic operation, and it also has a push button position locking mechanism improving user experience.
- Ingress Protection (IP)
  - » IP20 MCCB plug out condition.
  - » IP40 MCCB plug in condition.

The mechanism consists of a safety lock which is connected to the rear plate by using a pin. It is spring loaded and is capable of locking itself against a corresponding surface in the plug-in base when the MCCB is switched ON. The mechanism prevents the insertion of MCCB which if it is in ON condition.

The Kit also includes contact stud plugs which are fastened to the MCCB terminals and make electric contact with the Plug-in base terminals through socket assemblies (Jaw assembly in case of DZ7 Plug-in).

Handle is inserted to the terminal side of the MCCB which ensures easy removal of the breaker from Plug-in base in OFF condition. In DZ7 Plug-in, metal handle rods are provided for ergonomic loading and unloading the moving kit into the fixed kit. The driving mechanism is then used to plug-in the MCCB. DZ7 Plug-in also comes with shrouds for MCCB to meet IP requirements.

# **Specifications**

Versions		Plug-in DZ1	Plug-in DZ2	Plug-in DZ4	Plug-in DZ6	Plug-in DZ7
Maximum Rated	Electronic Release	144 A	160	250	360	720
current(A)	Thermal Magnetic Release	144 A		225	360	720
Max Operating Voltage Ue (Vac)		500	690	690 690		690
Rated frequency (Hz)				50/60		
Dimension (mm)	3P	75 x 1	71 x 60	105 x 220 x 70	120 x 282 x 100	268 x 369 x 194
W x H x D [Without MCCB]	4P	100 x	171 x 60	140 x 220 x 70	160 x 282 x 100	328 x 369 x 194
Dimension (mm)	3P	75 x 171 x 60	75 x 171 x 135	105 x 220 x 160	120 x 282 x 155	268 x 369 x 204
W x H x D [With MCCB]	4P	100 x 171 x 60	100 x 171 x 135	140 x 220 x 160	160 x 282 x 155	328 x 369 x 204
Short time withstand, Icw (kA) for Plug-in contacts		25 kA for 30 ms		38 kA for 40 ms	50 kA for 50 ms	50 kA for 50 ms
Insulation Voltage Ui (Vac)		800 1000		1000	1000	1000
Impulse Voltage Uimp (kV)				8		
Safety feature				Safety Interlo		
-				Aux. Indicatio		
Mechanical Life				200 operation IP 20 (Without bro		
Ingress Protection				IP 40 (With brea		
Mounting orientation				Vertical / Horizo	ontal	
	Direct ROM	Yes	Yes	Yes	Yes	Yes
	Extended ROM	Yes	Yes	Yes	Yes	Yes
	Motor Operator	Yes	Yes	Yes	Yes	Yes
External	Spreader	Yes	Yes	Yes	Yes	Yes
Accessory Suitability	Rear Terminals	Yes	Yes	Yes	Yes	Yes
	Box Clamps	Yes	Yes	Yes	Yes	No
	MIL		es ront Slider type)	Yes (Cable, Front Slider and Baseplate Type)	Yes (Cable and BaseplateType)	NO
	Keylock			Yes (through RO	DM)	

## **Draw-out Module**

Draw-out MCCBs are used in applications which demand higher levels of service continuity. In case the MCCB develops a fault and needs replacement, MCCB can be safely removed from the draw-out system without removing the power connections and replaced with new MCCB.

Draw-out module facilitates all other electrical accessories like UV, shunt, EOM and release can be wired through secondary isolating contacts (SIC).

In test position, accessories and wiring schemes can be tested without removing the MCCB from the cradle.

In disconnected position, it offers complete isolation from the incoming supply and hence enhances the safety of operator or user.

#### Salient features

- It offers Locking in three distinct Positions:
  - » Disconnect: the device is disconnected completely, both power and auxiliary connections are disconnected and can be removed from fixed base safely
  - » Test: the power circuit is disconnected, and device is ready to check auxiliary operations
  - » Connect: the power circuit is connected

All these positions are provided with electrical and mechanical indications.

 Secondary Isolating Contacts (SIC) are automatic and side mounted.

- Safety lock along with ROM or EOM, ensures that the draw-in or draw-out of breaker is possible only in OFF condition.
- MCCB cannot be switched ON when the racking handle is inserted.
- 'Disengage latch' reliably holds the breaker with cradle in disconnected position, to ensure operator safety.
- Pad lock has been provided to prevent unauthorised drawin or draw-out operation. Termination region on draw-out base (cradle) is same as that of MCCB, hence termination capacity and termination accessories like box clamp, rear terminal and spreader links are same and uses same breaker accessories like phase barrier, shroud, and mechanical interlock.

## **Constructional features:**

The new Dsine DZ MCCB Draw-out modules consists of three basic parts:

- Draw-out fixed part, can be either panel mounted, or rail mounted (Only Panel Mounted for DZ7 Draw-out)
- Conversion kit, consisting of moving parts, which is attached to the standard circuit breaker
- Racking handle

Draw-out fixed part has Plug-in base, which has provisions to accommodate socket assemblies or jaw assemblies, IP covers, finger shields and terminals. Side plate assemblies of Draw-out module has racking mechanism, Position lock mechanism, Pad locking mechanism, cradle secondary isolating contacts (SIC) and electrical indication. It also has a panel kit facilitating closed door operation and giving mechanical indication.

These side plate assemblies are assembled with Plug-in base.

Conversion kit contains two rear plate assemblies & special ROM for safety features.

These rear plate assemblies are to be fastened to the rear side of MCCB by means of four screws by user.

Power electrical contact plugs are fastened to the MCCB terminals and make electric contact with the cradle terminals through socket assemblies.

The termination region of MCCB ensures IP40 from front fascia to end user in case MCCB is removed from fixed base.

Rotary operating mechanism is to be attached to the top of MCCB with 4 mounting screws. It has all the safety feature to ensures the rack-in/out of the breaker only in OFF condition.

\*We can provide all the feature of rotary handles in draw-out also such as door sensor, door interlock, etc.

# **Specifications**

Versions		Draw-out DZ4	Draw-out DZ6	Draw-out DZ7			
	Electronic Release	250	360	720			
Maximum Rated current(A)	Thermal Magnetic Release	225	360	720			
Max Operating Voltage Ue (Vac)		690	690	690			
Rated frequency (Hz)			50/60				
Dimension (mm), W x H x D	3P	228 x 220 x 213	243 x 282 x 216.3	304 x 338 x 248			
[Without MCCB]  Dimension (mm), W x H x D	4P	263 x 220 x 213	283 x 282 x 216.3	364 x 338 x 248			
Dimension (mm), W x H x D	3P	228 x 220 x 224.3	243 x 282 x 229.2	304 x 338 x 256			
[With MCCB]	4P	263 x 220 x 224.3	283 x 282 x 229.2	364 x 338 x 256			
Short time withstand, Icw (kA) for Plug-in contacts		38 kA for 40 ms	50 kA for 50 ms	50 kA for 50 ms			
Insulation Voltage Ui (Vac)		1000	1000				
Impulse Voltage Uimp (kV)			8				
		ROM Safety Interlock					
		Padlock					
		Disengage Latch					
Safety feature		Rack In Handle Safety Interlock					
		3 position push button lock					
		Mechanical Indication					
			Electrical Indication				
		N	Safety Shutter for plug in contacts				
Mechanical Life			200 operations				
Ingress Protection			IP 20 (Without breaker)				
ingress Frotection			IP 40 (With breaker)				
Mounting orientation			Vertical / Horizontal				
	Direct ROM	Yes	Yes	Yes			
	Extended ROM	No	No	No			
	Motor Operator	Yes*	Yes*	Yes*			
External Accessory Suitability	MIL	Yes (Cable and Base Plate type)	Yes (Cable and Base Plate type)	NO			
	Spreader	Yes	Yes	Yes			
	Rear Terminals	Yes	Yes	Yes			
	Box Clamps	Yes	Yes	No			
<u> </u>	Keylock		Yes (through ROM)				

<sup>\*</sup> With Drawout Motor Operator Interlock

# **Electrical Operating Mechanism**

Motor Operator is a premium external accessory to Moulded Case Circuit Breaker (MCCB). Motor Operators are widely used for remote switching and auto source changeover schemes. Motor operators find applications in industry segment, infrastructure and building segment with critical installation areas like hospitals.

Motor operator address MCCB needs of Reliable auto source switching, process industries,

Infrastructure application, optimized energy cost and digital connectivity.

# OZI-EOM

#### **Salient Features**

- Compact motor operator with size 87 x 75 x 100 mm (Hx WxD) in DZ1 & DZ2.
- Operates within a wide voltage band (150 VAC 270 VAC)
- Features an auto pop-up type padlock. Padlocking is possible in both ON and OFF state of MCCB.
- Selector Switch with three distinct modes of operation as follows:
  - Auto mode Unit can operate electrically. Manual operations and padlocking are disabled
  - **Manual Mode** Unit can be operated manually. Electrical operations and padlocking are disabled.
  - **Lock Mode** Unit cannot be operated. Auto and Manual modes are disabled. Padlocking is possible.
- > Ingress protection complying IP40
- 'Single hand hinge-out' feature with retention snaps for easy access to the internal accessories of MCCB like UV/SR & AUX/ TAC. No need to un-mount EOM for mounting / replacing internal accessories.

- Ergonomic supplementary handle for easy manua operations.
- Endurance life up to 100% mechanical life of MCCB operations for reliable switching.
- Easy access to MCCB termination. No need to un-mount EOM for assembly and maintenance of MCCB termination
- Flag indication of ON/OFF & charge/Discharge state Common design for 3P and 4P
- > Easy access to protection setting on MCCB.
- True indication for ON/OFF & Trip.
- Electrical indication of charge/discharge state through Lamp.
- > Electrical indication of Auto/Manual mode through Lamp.
- Voltage error indicator LED at MO front facia for voltage error <150 or >270 V in case of DZ6 & DZ7 EOMs

# **Specifications**

Specification	DZ1	DZ2	DZ6	DZ7	
Operating voltage (V AC)	240 V AC/110 V DC 240 V AC/110 V I		240 V AC/110 V DC	240 V AC/110 V DC	
Operating voltage (%)	75-110 %	75-110 %	75-110 %	75-110 %	
Closing time (ms)	<80	<80	<80	<80	
Opening time(ms)	<100	<100	<600	<700	
Power consumption (VA)	500	500	500	500	
Life/no of operation	25000	30000	20000	20000	
IP Protection	IP40	IP40	IP40	IP40	
Operating frequency	2/min	2/min	1/min	1/min	
Min control pulse time(ms)	50-150	150	50	50	

# **Mechanical Interlock (MIL)**

In source change-over systems, Mechanical Interlock (MIL) prevents connection to both sources at the same time.

When two MCCBs are working in parallel, there may be a requirement to interlock two MCCBs mechanically so that when one is being turned ON, the other remains in OFF position, so that only one MCCB may be closed at a time.

MIL also finds its application in ASTS for additional safety, especially in an environment having high vibrations. MILs are used along with Electrical interlock.

The new dsine DZ has three versions of Mechanical Interlock depending upon their philosophy of interlocking.

Mechanical Interlocking kit range	DZ1	DZ2	DZ4	DZ6	DZ7
Front Slider	✓	✓	✓	-	-
Rear Base Plate	-	-	✓	✓	✓
Cable Base Plate	✓	✓	-	✓	-

#### 1) Mechanical Interlock - Front Slider

Two MCCBs installed side by side can be interlocked using Front MIL. Interlocking is carried out by means of front slider kit which prevents the unintentional operation of interlocked MCCB through mechanical feedback. It is applicable from DZ1 to DZ4 having the possible combinations:

#### MCCB INTERLOCKING MATRIX - Front Slider

MCCB	DZ1	DZ2	DZ4
DZ1	✓		
DZ2		✓	✓
DZ4		✓	✓

# 2) Mechanical Interlock - Rear Base Plate

Two MCCBs can be interlocked using Rear Base plate MIL installed side by side on base plate. Interlocking is carried out by means of mechanism located behind the base plate of installed MCCBs. This gives flexibility to operator or user to access the front controls and status indication of MCCB. It is applicable for the DZ6 range with interlocking provision as follows:

MCCB	DZ4	DZ6	DZ7
DZ4	✓	✓	
DZ6		✓	
DZ7			✓

#### **Constructional Detail**

MIL - Rear base plate is suitable for the fixed, plug-in and drawout versions of MCCBs, both 3P and 4P. It consists of a base plate, two operating lever mechanisms and MCCB specific mounting plates with actuators. Operating lever mechanisms are assembled to the base plate with suitable actuators at user end. Suitable mounting plates are mounted to the base plate upon which MCCBs are mounted. A complete base plate assembly can be installed horizontally or vertically on the mounting plate of the panel.





#### Some of the salient features are

- Min. 26 mm clearance between 3P and 4P with spreaders and Rear termination with link to the base plate
- Common design for 3P and 4P
- Suitable for all types of terminations applicable to basic MCCB

## 3) Mechanical Interlock - Rear Base Plate with cable

Two MCCBs can be interlocked using this Rear Base plate MIL with cable installed even 5m apart. Interlocking is carried out by means of mechanism located behind the base plate of installed MCCBs and feedback cable. This gives flexibility to

- Suitable for withdrawable Plug-in and Draw-out modules, with all type of MCCB terminations applicable
- Suitable for MCCBs having ROMs and EOMs
- > Suitable for horizontal or vertical mounting orientations

the operator or user to access the front controls and status in direction of MCCB and cable gives flexibility to installed at any distance up to 5m\* It is applicable from DZ1 to DZ6 MCCBs.

\*Note: Max. Cable length is 5m

MCCBs are mounted on the respective base plates and then cable is calibrated for interlocking. The position and orientation of two base plate assemblies can be flexibly installed away from each other in the panel.

# MCCB INTERLOCKING MATRIX

MCCB	DZ1	DZ2	DZ4	DZ6
DZ1	✓			
DZ2		✓	✓	✓
DZ4		✓	✓	✓
DZ6		✓	✓	✓

#### **Constructional Detail:**

MIL - Rear base plate with cable is suitable for the fixed, plug-in and draw-out version, both 3P and 4P. It consists of two base plates, with operating lever mechanisms, actuators and cable. The cable assembled between two operating lever mechanisms facilitates interlocking between two MCCBs. The


#### Some of the salient features are:


- Min. 26 mm clearance between 3P and 4P with spreaders and Rear termination with link to the base plate
- > Possible to interlock different MCCB frames
- > Common design for 3P and 4P
- Suitable for all types of terminations applicable to basic MCCB
- Suitable for withdrawable Plug-in and Draw-out modules, with all type of MCCB terminations applicable
- Suitable for MCCBs having ROMs and EOMs
- > Suitable for horizontal or vertical mounting orientations
- Cables are provided in the length of 1m, 3m and 5m depending on requirements.

#### Maintenance Guidelines:

- > Minimum cable bending radius of 80mm to be maintained.
- Cables should not be looped.
- > Cable should not be disturbed after calibration.
- Cable should be supported appropriately at required locations to prevent sagging.
- Re-calibration and verification to be done every 30 days to ensure there is no abuse with cable calibration.
- Calibration should be done by authorised service engineers only.


# **BASE PLATE SELECTION**






FOR ALL TYPE OF TERMINATION

# **OVERALL DIMENSIONS**





		Baseplate A		E		
	DZ1/2	DZ4	DZ6	DZ1/2	DZ4	DZ6
W	100	160	170	164	213	230
Х	222	264	344	282	349	412
Υ	70	94	104	75	105	120
Z	204	242	312	264	327	390

# **CABLE SELECTION MATRIX**

		DZ1 I		D	DZ2 DZ		Z4 D2		<b>Z</b> 6
		Α	В	Α	В	Α	В	Α	В
DZ1	Α	L	L						
DZI	В		М						
DZ2	А			L	L	L	М	L	М
DZZ	В				М	L	М	М	Н
DZ4	А					L	М	L	М
DZ4	В						Н	М	Н
DZ6	А	M				Н			
DZO	В	В					Н		

All types of cables: L, M and H come in the lengths of 1m, 3m and 5m.

# **Terminations**

			DZ0	DZ1	DZ2	DZ4	DZ6	DZ7
	Box Clamp	Flexible cable	2mm²to 35mm²	2.5mm² to 70mm²	2.5mm² to 70mm²	50mm² to 150mm²	120mm² to 240mm²	-
		Rigid Cable	2mm² to 35mm²	2.5mm² to 95mm²	2.5mm² to 95mm²	50mm² to 185mm²	120mm² to 300mm²	
		Tightening Torque	2.5 to 4 Nm	Max 6 Nm	Max 6 Nm	Max 15 Nm	Max 20 Nm	
o o o	Spreader Links	Cable	25mm² to 70mm²	-	-	25mm to 35mm wide	25mm to 50mm wide	2x150mm² to 2x300mm²
		Link	(16 to 25)mm wide X (3 to 5) mm thick	-	-			(30 to 50)mm wide X (8 to 16) mm thick
		Tightening Torque	2.5 to 6 Nm	Max 6 Nm	Max 6 Nm	Max 15 Nm	Max 25 Nm	Max 70 Nm
	Rear Terminal	Cable	-	-	-	50mm² to 185mm²	120mm² to 300mm²	120mm <sup>2</sup> to 240mm <sup>2</sup>
		Link	-	-	-	20mm wide X (4 to 10) mm thick	30mm wide X (4 to 10) mm thick	30mm wide X (4 to 10) mm thick
		Tightening Torque	-	Max 6 Nm	Max 6 Nm	Max 15 Nm	Max 20 Nm	Max 25 Nm
	Direct Terminal	Cable	2.5mm² to 35mm²	2.5mm <sup>2</sup> to 50mm <sup>2</sup>	2.5mm² to 35mm²	Max 25mm wide	(25 to 30)mm wide X (4 to 10) mm thick	-
		Link	(11 to 17)mm wide X (2 to 5) mm thick	(11 to 16)mm wide X (2 to 5) mm thick	(11 to 16)mm wide X (2 to 5) mm thick			(30 to 50)mm wide X (8 to 16) mm thick
		Tightening Torque	2.5 to 6 Nm	Max 6 Nm	Max 6 Nm	Max 15 Nm	Max 25 Nm	Max 70 Nm
			06.5 7 16max	<u>96.5</u> 16max	06.5 77 16max	25	30 010.5	BUSBAR DIMENSION JETO ESDA  911 15  15  15  15  15  15  15  15  15  1

## **Electronic Modules**

#### **M3U Communication Module**

M3U Communication module is the solution for connecting MCCBs to a Modbus network for remote supervision and control of circuit breaker.

#### Feature:

- MODBUS communication interface for all MCCB's -Thermal Magnetic, switch disconnector (Status Communication) and Electronic (status and parameter)
- Separate status indication for Trip indication (TAC) and Fault Trip Indication (ETAC) with electronic trip units
- Mechanical operation counter
- Remote operation Close, Open and Reset via communication with motor version
- > EMI/EMC Compliant as per IEC 60947-2
- > DIN rail mountable
- Special stacking connector to stack multiple modules on DIN rail without using connecting wires



Specification				
Module		Modbus Memory Management Unit (M3U)		
Module Location		Sub Module		
Protocol		Modbus RTU		
David Data (hna)	Options	4800 / 9600 / 19200 / 38400 / 57600 / Auto		
Baud Rate (bps)	Default	9600		
Add.		1-247		
Devite	Options	Even/Odd/None		
Parity	Default	None		
Care Dia	Options	1/2		
Stop Bit	Default	1		
Input Voltage Rated		240V DC ±20%		
Physical Medium		RS 485 2W		
LED Indication		Power		
		Communication		
Functions				
Status Indication				
AUX (ON/OFF Status)		✓		
TAC (Trip Indication)		✓		
ETAC (Fault Trip Indication)		✓		
Maintenace Indicators				
Mechanical Operation Counter		✓		
Comunication Remote Control Operations				
Open, Close & Reset		✓		

#### **Zone Selective Interlocking (ZSI) Module**

Zone selective interlocking is a method which allows two or more circuit breakers to communicate with each other so that short circuit or ground fault can be cleared by the breaker closest to the fault with a minimum time delay. Module is a part of dsine-DZ MCCB system of iTRP-4 and iTRP-5 only. Enables signaling between upstream ACB (U Power Omega) or MCCB (iTRP-4/iTRP-5).

ZSI module can be connected to 15 downstream breakers with auxiliary supply.

The module can be used to coordinate the system for short circuit faults or earth faults or both.

The module is DIN rail mounted and has to be hardwired with downstream breakers.

#### Feature:

- Zone selective interlocking for Short circuit or ground fault or both
- > EMI/EMC Compliant as per IEC-60947-2
- > DIN rain mounted



Specification			
Module	Zone Selective Interlocking Module		
Input Voltage Rated	24VDC ± 20%		
Payer Option	Self-powered		
Power Option	Auxiliary supply		
Maximum Current	10mA @ 24VDC		
Configuration	Hardwired		
Type of Protection	Short Circuit / Ground Fault / Both		
Maximum length between two ZSI Module	300m		
Mayimum number of Circuit Breakers to Dougatroom (701 Out)	3 Nos (Self-powered)		
Maximum number of Circuit Breakers to Downstream (ZSI Out)	15 Nos (Auxiliary Powered)		
LED Indication	1-Power (Green LED) - continuous ON		

#### **Temperature Module**

Overheating of the busbar/cables can reduce the life of the insulation, busbar, cables and even breakers. Periodic loading conditions can cause the metal to heat and cool continuously

resulting in the deterioration of the same and loosening of the joints, which is one of the major cause of short circuit fault.

#### Some of the causes of overheating are as follows

Any of the following reasons can lead to heat generation at the breaker terminal.

- > Improper termination
- > Improper Bus bar design
- > Loose joints
- > De-rating not considered while selection of breaker
- Eddy currents

Temperature module senses temperature through thermistors connected at each pole of MCCBs. It sends the data to trip unit and to remote system through communication module thus offering temperature metering & over temperature protection functionality.



Specification			
Module	Temperature Module		
Module location	Sub module		
Input Voltage Rated	24VDC ± 20%		
Metering Temperature Range	-20 to 135 °C		
Protection temperature Range	80-115 °C		
Step Size Range	1 °C		
Pre alarm Range	50% - 95%		
Step Size (Pre alarm)	1%		
Accuracy	±2°C		
Mode	None, Trip, Alarm		
Time Delay	1 Min		
Indication	5 Leds 1 LED Power (Green Colour continuous) 4 LED - Over Temperature per sensor (Red Colour continuous) LED Behaviour: a. Pre -alarm - the respective red LED will blink 500ms ON/ 500ms OFF b. Trip - the respective red LED will blink 100ms ON/100ms OFF. c. OFF - Temperature below set threshold		
Sensor	4 Thermistor		
Sensor length	1 m each		
Module mounting	Din rail		

### **Programmable Relay Module (PRM)**

Programmable relay module consists of 4 configurable potential free relay contacts -2 change over contacts and 2 NO contacts.

PRM can be used with electronic breaker or conventional thermal magnetic breaker along with communication module. With thermal magnetic breaker, the ON/OFF/TRIP status is indicated through the relays.

Also remote operation command is executed through one of the relay.

- 4 Programmable relay Contacts 2 C/O & 2 NO
- > Remote annunciation
- > Breaker ON/OFF/Trip status indication
- > EMI/EMC Compliant as per IEC -60947-2
- > DIN rail mountable



Specification		
Module	Programmable Relay Module	
Input Voltage Rated	24VDC ± 20%	
LED Indications	1 LED for Power (Green LED) blinking:- Standalone - 100msec ON/ 100msec OFF On CAN Bus - 500msec ON/ 500msec OFF	
	4 LED for Relay output status (Red LED Steady ON, on relay activation)	
Relay contact	4 configurable contacts: 2 change over contacts + 2 NO contacts	
	6 Amp, 250VAC/24VDC	
Maximum switching Power	1500 VA/150W	
Relay activation sources	Trip Status of all the protections offered by iTRP-4 & iTRP-5. Alarm Status of basic protections in iTRP-4 & iTRP-5. Breaker Status – ON / OFF / TRIP	

# **External Neutral Sensor (ENS)**

External Neutral Sensors ENS provides solution for addressing the requirements of 3-phase 4-wire system wherein the neutral pole is not included in the MCCB.

ENS are suitable for electronic release type dsine DZ MCCBs.

ENS offers neutral current sensing when used with MCCBs equipped with iTRP-1 to iTRP-4 releases, as well as current and voltage sensing for MCCBs equipped with iTRP-5 releases.

#### **Salient Features**

- Current sensing through Rogowski coils offering a high linearity in current sensing
- > Suitable for voltage sensing for Energy metering purposes
- > Connection via micro USB for hassle-free connection
- > Types of following termination are offered
  - » Prepared Cables lug
  - » Spreaders
  - » Direct Links



МССВ	Suitable ENS Type	Current Rating
DZ1/DZ2	DZ1/2 ENS	25A - 160A
DZ4	DZ4 ENS	160A - 250A
DZ6	DZ6 ENS	250A - 400A
DZ7	DZ7 ENS	400A - 800A
DZ7 1000A	DZ7-1000A ENS	1000A

# Additional Technical Information

#### **Altitude Correction Factors**

Altitude does not significantly affect circuit breaker characteristics up to 2000 m. Above this altitude, it is necessary to take into account the decrease in the dielectric strength and cooling capacity of air.

The following tables give the altitude correction factors for various circuit breaker characteristics

	Description		De-rating Factor			
			<2000 m	3000 m	4000 m	5000 m
D71 D77	Rated Operational Voltage	Ue	1.00	0.90	0.80	0.70
DZ1-DZ7	Rated Nominal Current	In	1.00	0.97	0.94	0.91
	Insulation Voltage	Ui	1.00	0.78	0.69	0.61
	Impulse Withstand Voltage	U <sub>imp</sub>	1.00	0.78	0.69	0.61

#### **Temperature Derating Details**

Dsine DZ derating is 1% of  $I_n$ /°C, starting from 50°C for TMR For example,

 $I_n{=}100A$  for DZ1 TMR, derating will start from  $50^{\circ}C$  to  $70^{\circ}C$  At  $60^{\circ}C$  (0  $I_n$  = 100A

Deration would be (60°C -50°C) x 1A

= 10°C x 1A

= 10A

i.e. 100A-10A = 90A

Dsine DZ derating is 1% of  $I_n/^{\circ}C$ , starting from 55°C for MPR For example,

 $I_n = 100 A$  for DZ1 MPR, derating will start from 55°C to 70°C At 60°C (  $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$  At 60°C (  $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$  At 60°C (  $\!\!\!$   $\!\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$  At 60°C (  $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!$   $\!\!\!\!$   $\!\!\!$ 

Deration would be (60°C -55°C) x 1A

= 5°C x 1A

= 5A

i.e. 100A-5A = 95A

#### **Power Loss Data**

The power loss of an electrical device is essential for determining the overall system efficiency, measured in watts. According to Annex G of IEC-60947-2, the total power loss of a circuit breaker is calculated by multiplying the power loss per pole by the number of poles. This measurement, conducted under rated current in free air and with minimal voltage drop across the terminals under cold conditions, provides an indication of the heat generated in specific operational scenarios.

Frame	Rating (A)	Power loss per pole (W)
	16	2.1
	20	3.3
	25	5.2
DZ0	32	4.0
	40	6.4
	50	4.0
	63	6.5
	80	7.2
	100	10.5
	125	16.4

Frame	Rating (A)	Power loss per pole (W)
	16	3.8
	20	6.0
	25	5.0
	32	8.2
	40	4.8
DZ1-TMR	50	7.5
DZ1-TIVIK	63	7.4
	80	8.0
	100	8.0
	125	9.4
	160	14.1
	200	20

Frame	Rating (A)	Power loss per pole (W)
DZ1-MPR	25	1.5
	40	2.2
	63	3.0
	100	5.0
	160	12.8
	200	18

Frame	Rating (A)	Power loss per pole (W)
	16	4.0
	20	4.0
	25	4.4
	32	4.5
DZ2-TMR	40	5.0
	50	5.6
	63	6.3
	80	7.8
	100	9.7
	125	12.2
	160	19.1

Frame	Rating (A)	Power loss per pole (W)	
DZ2-MPRDZ2- ETU	25	4.0	
	40	4.5	
	63	5.6	
	100	9.5	
	160	17.5	

Frame	Rating (A)	Power loss per pole (W)
	160	17.3
DZ4-TMR	200	20.6
	250	25.7

Frame	Rating (A)	Power loss per pole (W)
DZ4-MPRDZ4- ETU	160	7.7
	200	11
	250	19

Frame	Rating (A)	Power loss per pole (W				
	200	11.6				
DZ6-TMR	250	16.1				
DZ6-TWK	320	25.4				
	400	42.7				

Frame	Rating (A)	Power loss per pole (W)
DZ6-MPRDZ6-	250	13.1
ETU	400	35.2


Frame	Rating (A)	Power loss per pole (W)
	500	31
DZ7-TMR	630	44
	800	70


Frame	Rating (A)	Power loss per pole (W)
DZ7-MPRDZ7- ETU	630	32.9
	800	58.7
	1000	

# **Characteristic Curves**


### **Trip Curves - Thermal Magnetic Release**

### iTMAF @12In

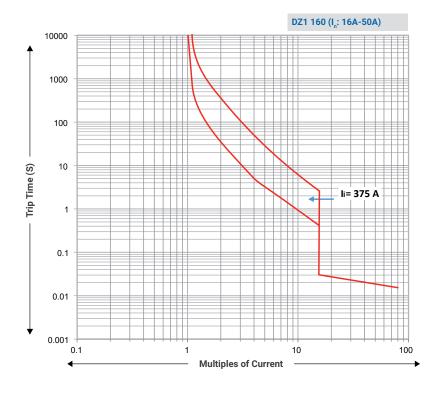

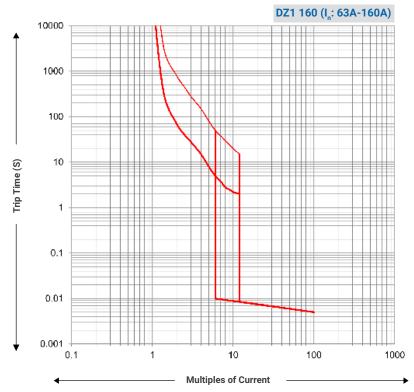


### **Trip Curves - Thermal Magnetic Release**

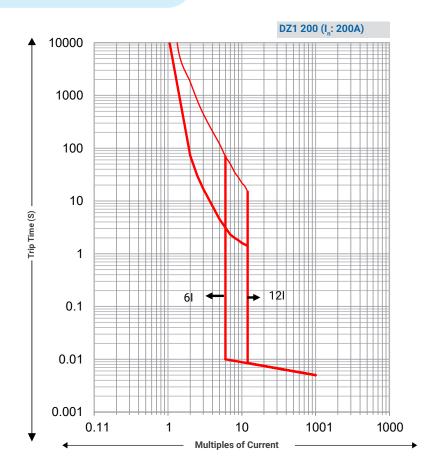


### **Trip Curves - Electronic Release (iTRP)**


### Overload 6Ir @ 3s

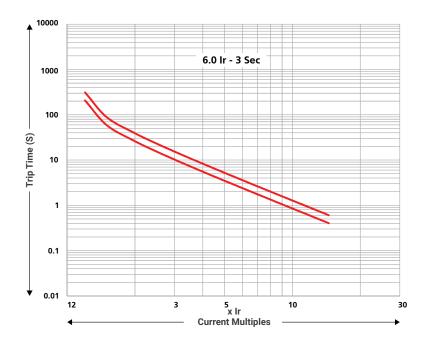


### Overload 7.21, @ 3s

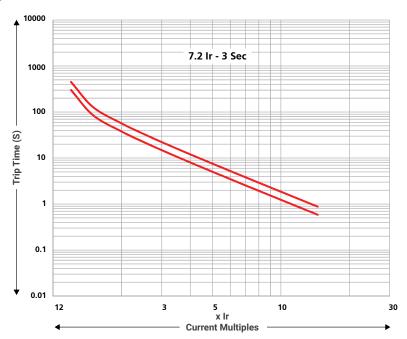

### Overload 6Ir @ 10s

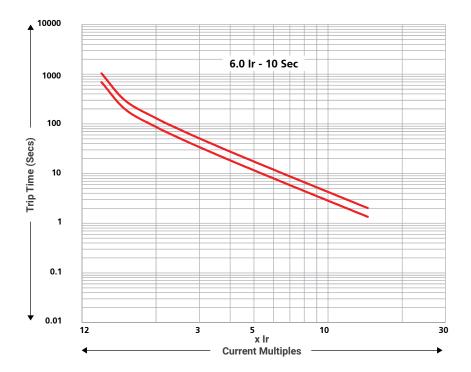


### **Overload 7.2I**<sub>r</sub> @ 10s

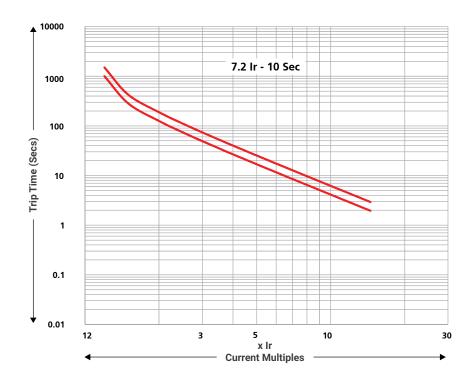


### **Trip Curves - Electronic Release (iTRP)**

#### **Short-Circuit & Instantaneous - iTRP-1**

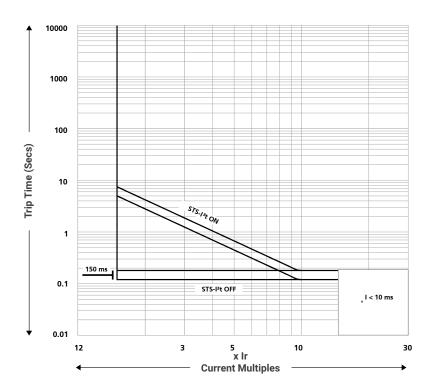


### Short-Circuit & Instantaneous - iTRP-2 / iTRP-3 / iTRP-3C / iTRP-4 / iTRP-5

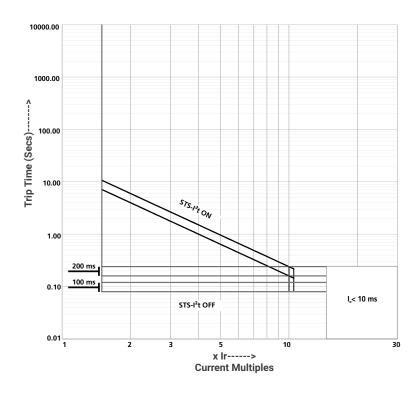


### **Trip Curves - Electronic Release (iTRP)**

### Earth Fault - iTRP-3 / iTRP-3C / iTRP-4 / iTRP-5

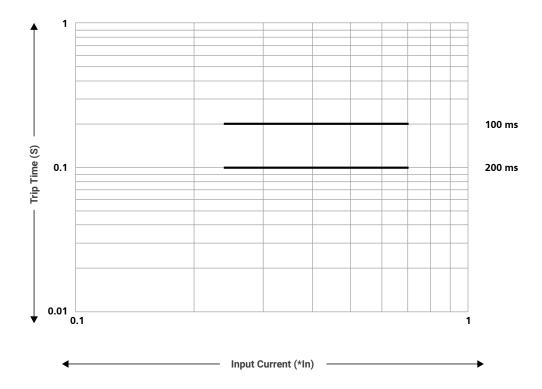


### **Current-Limiting Curve**

### **DZ** @ 415V

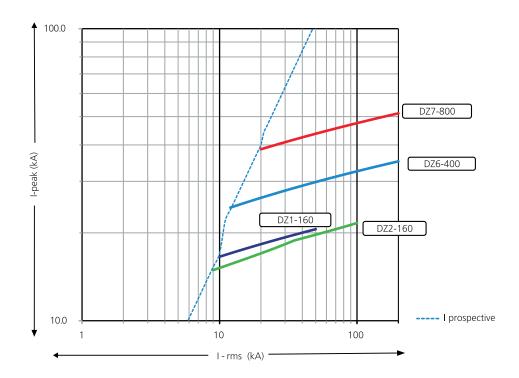


### **DZ** @ 690V

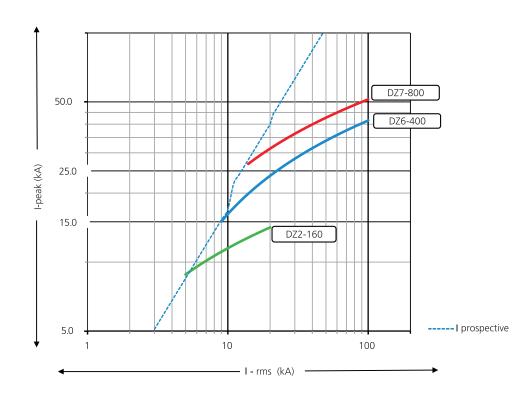


### **Energy-Limiting Curve**

### DZ @ 415V

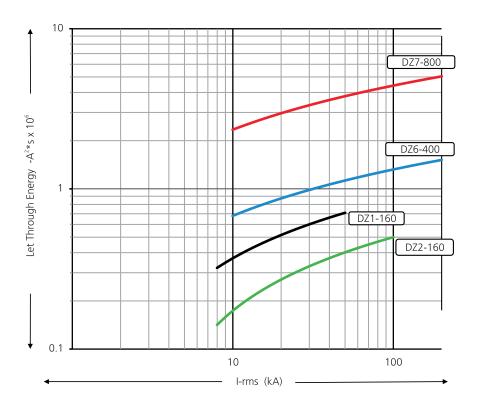


### **DZ** @ 690V

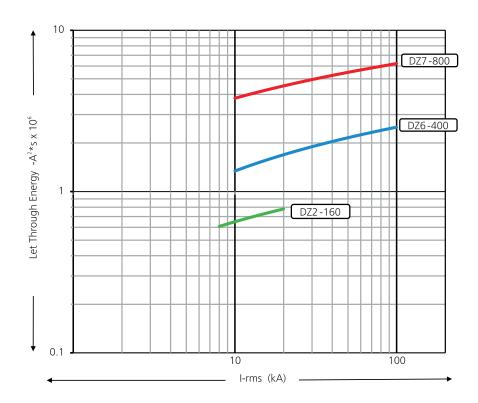


# **Dimensions**


#### **DZ0 Overall Dimensions**

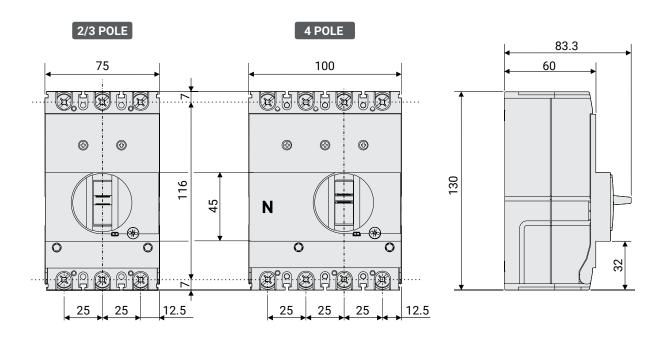


### **DZ0 Mounting Dimensions**

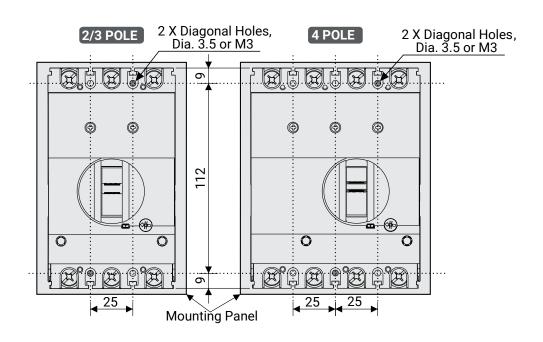


#### **DZ0 Panel Cutout**

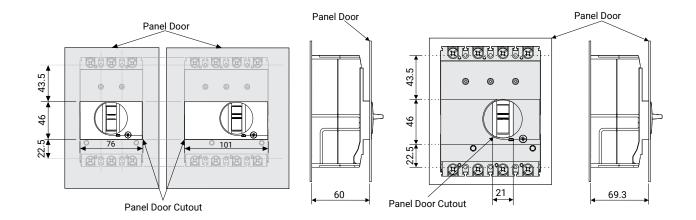


### **DZ0 Overall MCCB Dimensions with Spreader Links**

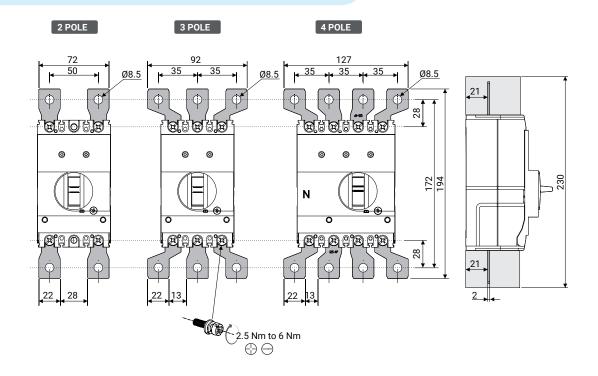

### **DZ1 Overall Dimensions**

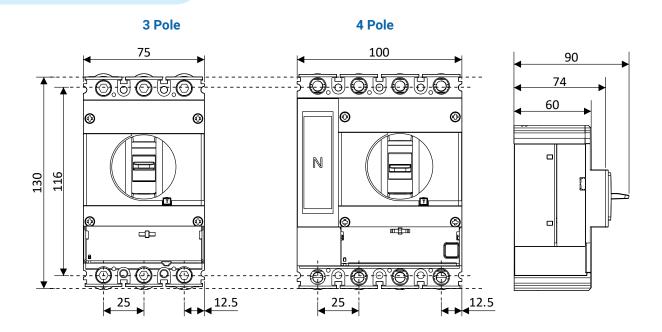


### **DZ1 Mounting Dimensions**

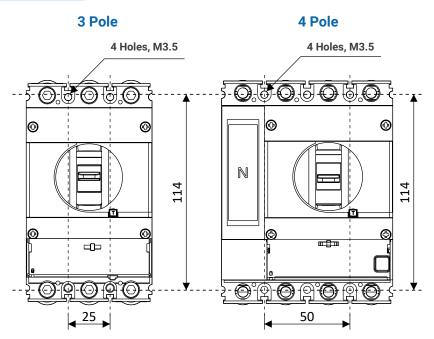


All dimensions are in mm

#### **DZ1 Panel Cutout**

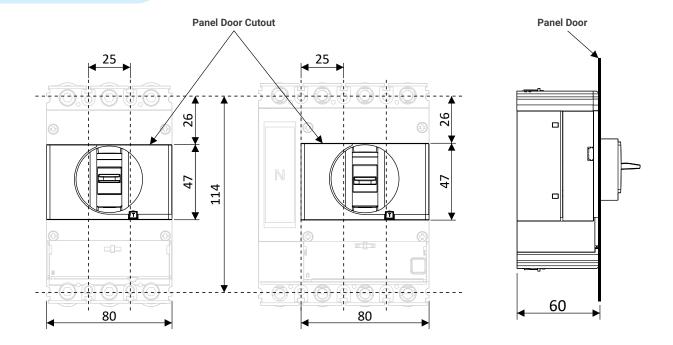


### **DZ1 Overall MCCB Dimensions with Spreader Links**

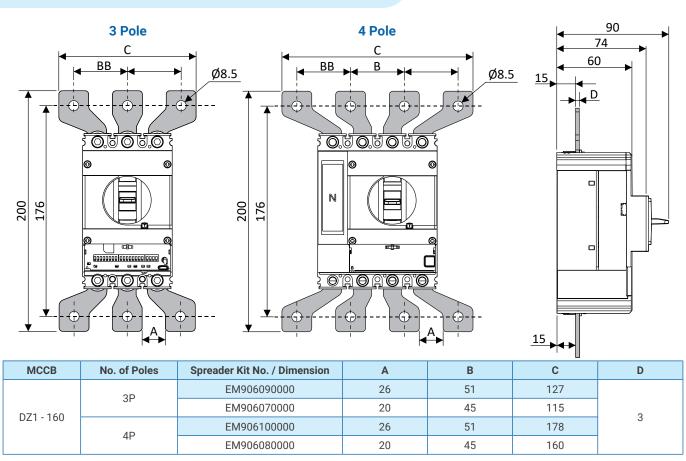


All dimensions are in mm


#### **DZ2 Overall Dimensions**

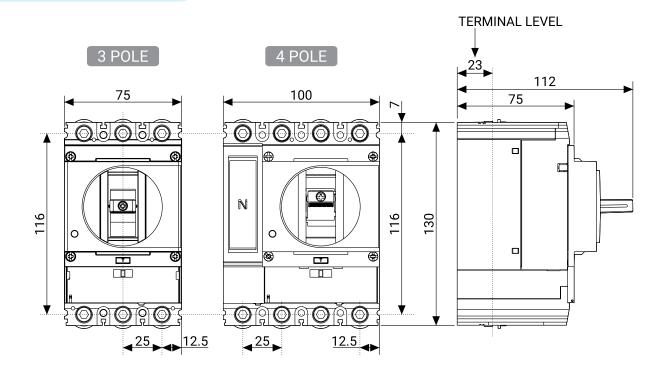


### **DZ2 Mounting Dimensions**

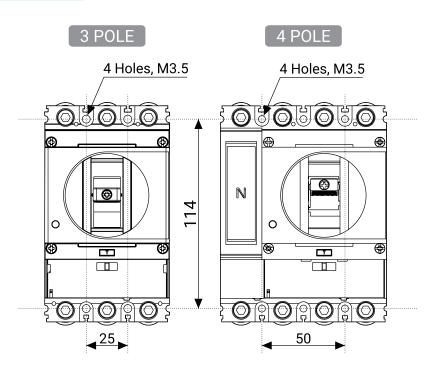

### **DZ2 Panel Cutout**

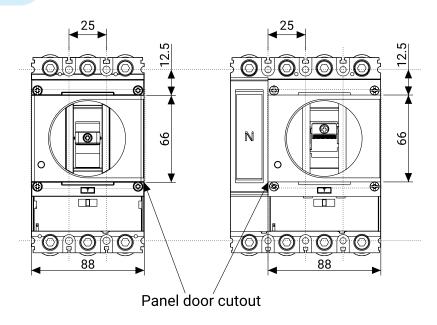


### **DZ2 Dimensions with Spreader Links**

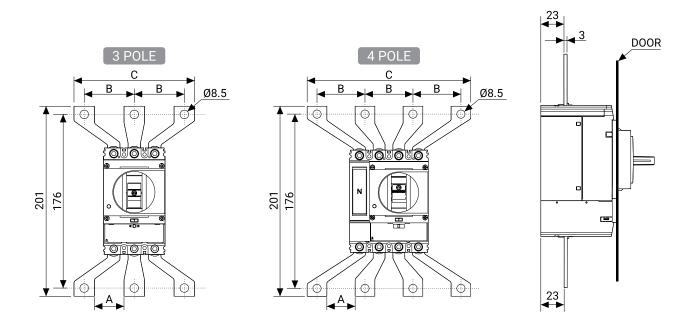


No. of Poles	Spreader Kit No. / Dimension	А	В	С
3P	EM906090000	26	51	127
	EM906070000	20	45	115
4P	EM906100000	26	51	178
	EM906080000	20	45	160


#### **DZ4 Overall Dimensions**

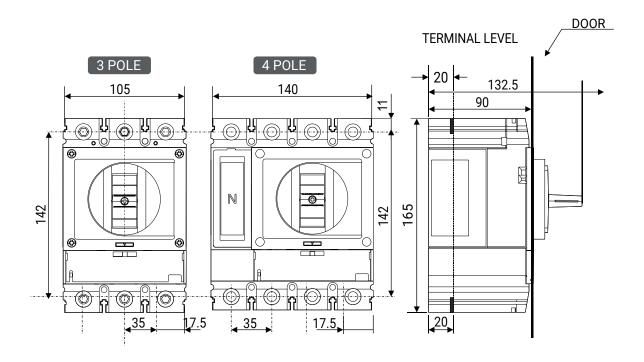


### **DZ4 Mounting Dimensions**

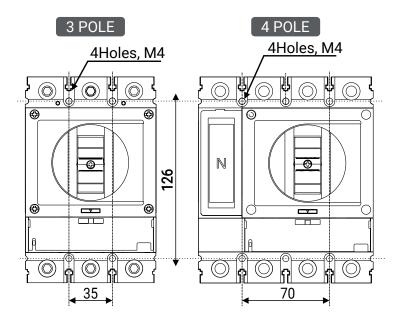

#### **DZ4 Panel Cutout**

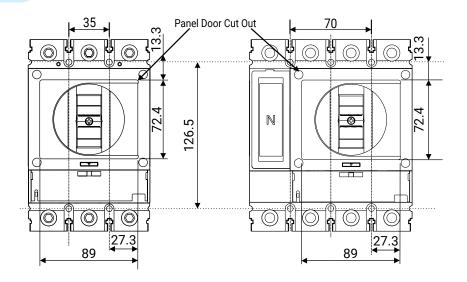


### **DZ4 Dimensions with Spreader Links**

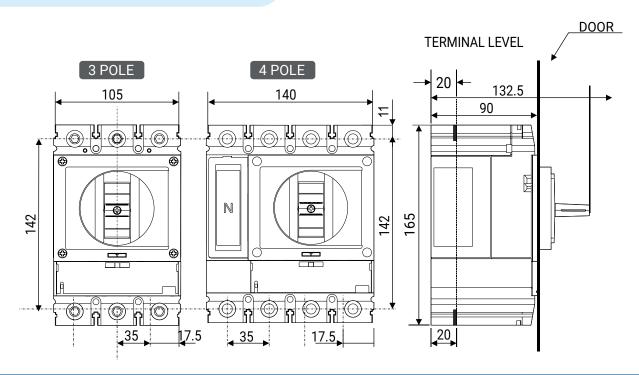


Variables	Spreader L	inks 20mm	Spreader Links 26mm		
variables	3P	4P	3P	4P	
W	130 180		157	218	
Н	262	262	262	262	
H1	232	232	228	228	
PW	30	30 30		35	
С	20	20	26	26	
Р	50	50	61	61	


#### **DZ6 Overall Dimensions**

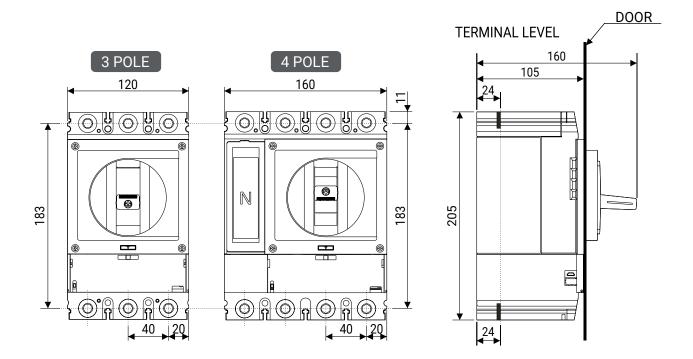


### **DZ6 Mounting Dimensions**

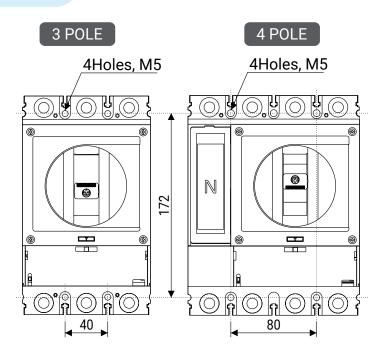

#### **DZ6 Panel Cutout**

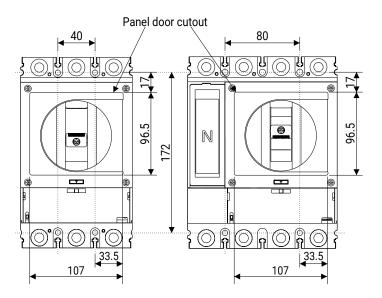


### **DZ6 Dimensions with Spreader Links**

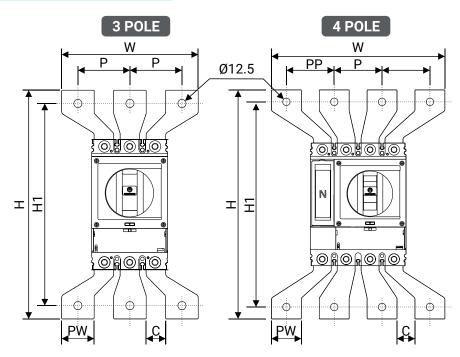


Variables	Spreader L	inks 20mm	Spreader Links 26mm		
variables	3P	4P	3P	4P	
W	210 290		172	238	
Н	353	383	313	313	
H1	313	343	273	273	
PW	W 50 50		40	40	
С	C 30		26	26	
Р	80	80	66	66	


#### **DZ7 Overall Dimensions**

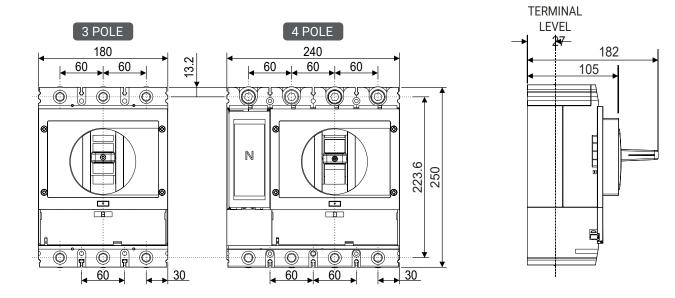


### **DZ7 Mounting Dimensions**

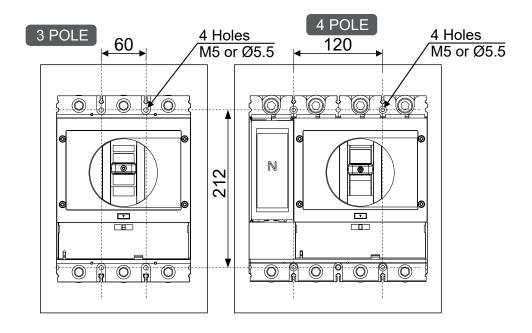


### **DZ7 Panel Cutout**

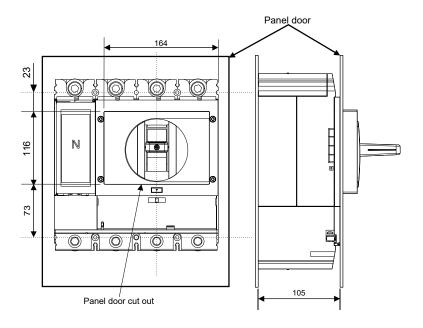


### **DZ7 Dimensions with Spreader Links**

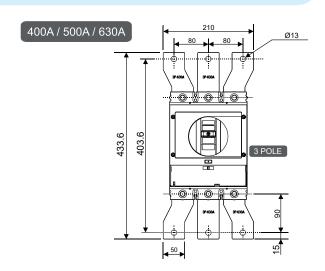


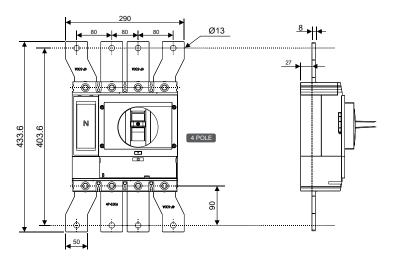



### **Rotary Operating Mechanism (ROM)**

### **Direct ROM**












 $\hbox{*\,Minimum hinge radius for Horizontal/Vertical MCCB installation}\\$ 


mm/in.	DZ0	DZ1	DZ2	DZ4	DZ6	DZ7
А	84.80	90.5	89	105.7	115.5	129.5
	3.34	3.56	3.5	4.14	4.54	5.09
В	51.30	56.5	55	65.8	74	79.6
	2.02	2.22	2.16	2.59	2.91	3.13
L	92.30 3.63				159 6.25	164.5 6.47
D	49.50	50	50	76.4	60	68
	1.94	1.96	1.96	3.00	2.36	2.67

### **Extended ROM**





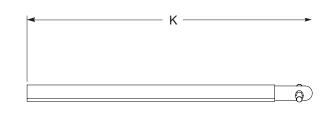


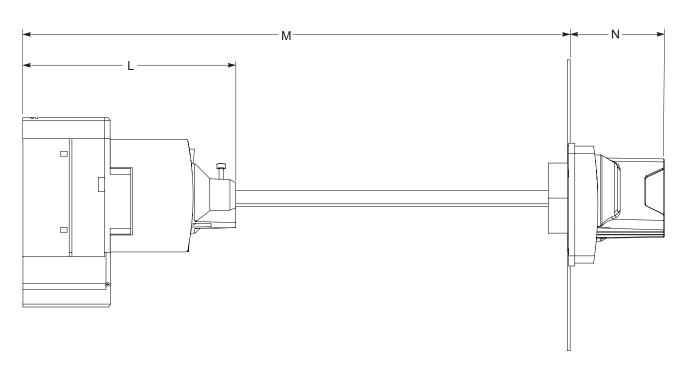



mm/in.	DZ0	DZ1	DZ2	DZ4	DZ6	DZ7	
G	80	80	80	80	80	80	
	3.14	3.14	3.14	3.14	3.14	3.14	
Н	85	85	85	85	85	85	
	3.34	3.34	3.34	3.34	3.34	3.34	
J	80.3 3.16					_	79.3 3.12
К	96	102.5	114.5	114.5	160.5	170.5	
	3.77	4.03	4.5	4.50	6.31	6.71	
L	139.6 147.5 5.49 5.80				178.9 7.04	205.5 8.09	217.7 8.57
М	154.1	162	174	193.4	220	232.2	
	6.06	6.37	6.85	7.61	8.67	9.14	
N	67	67	67	67	67	66.5	
	2.63	2.63	2.63	2.63	2.63	2.61	

### **Panel Cutouts Rotary Handle**













				i e	
mm/in.	DZ0	DZ1	DZ4	DZ6	DZ7
А	79	90	90	123	158
	3.11	3.54	3.54	4.84	6.22
В	10.50	24.5	24.5	43.3	52.2
	0.41	0.96	0.96	1.70	2.05
С	25.25	30	30	45	51.5
	0.99	1.18	1.18	1.77	2.02
D	25	25	25	40	60
	0.98	0.98	0.98	1.57	2.36
E	75.50	85	85	130	163
	2.97	3.34	3.34	5.11	6.41
F	60.50	47.5	47.5	67	81
	2.38	1.87	1.87	2.63	3.18
G	51.50	66.5	66.5	105	131.2
	2.02	2.61	2.61	4.13	5.16
Н	10.50 9.50	10.50	10.50	19	30
	0.41(3P) 0.37(4P	0.41	0.41	0.74	1.18
ØJ	51	51	51	51	51
	2.00	2.00	2.00	2.00	2.00
ØK	12.2 12.2		12.2	12.2	12.2
	0.48 0.48		0.48	0.48	0.48
ØL	76	76	76	76	76
	2.99	2.99	2.99	2.99	2.99
ØM	4.5	4.5	4.5	4.5	4.5
	0.17	0.17	0.17	0.17	0.17

### **Plug-in Module**











mm/in.	Α	B1	B2	С	D1	D2	Е	F	G	Н	J	K	L	М	N	Р
DZ1	171	75	100	25	62	87	51	151	157	60	18	36	150	120	166	20.5
	6.73	2.95	3.93	0.98	2.44	3.42	2.01	5.94	6.81	2.36	0.70	1.41	5.90	4.72	6.53	0.80
DZ4	220	105	140	35	87	122	51	181	197	70	20	36	202.5	160	201	27.5
	8.66	4.13	5.51	1.37	3.42	4.80	2.01	7.12	7.75	2.75	0.78	1.41	7.97	6.29	7.91	1.08
DZ6	282 11.10	120 4.72	160 6.23	40 1.57	98 3.85	138 5.43	88 3.46		260 10.23	100 3.93			209 8.22	155 6.10	212 8.34	38.5 1.51


#### 3 Pole









3 Pole / 4 Pole




mm/in.	Α	В	С	D1	D2	Е	F	G	Н
DZ1	231.5	211.5	61	147	208	151	Ø 8.5	3	23
	9.11	8.32	2.40	5.78	8.18	5.94	Ø 0.33	0.12	0.9
DZ4	317	283	61	157	218	151	Ø 12.5	5	20
	12.48	11.14	2.40	6.18	8.58	5.94	Ø 0.49	0.19	0.78
DZ6	430	390	80	210	290	181	Ø 12.5	5	24
	16.92	15.35	3.14	8.26	11.41	7.12	Ø 0.49	0.19	0.94


### **DZ7 Plug-in base**










### **DZ7 Plug-in base with Terminal extension spreaders**









### DZ7 Plug-in assembly in different positions











### **DZ Drawout - Fixed Kit**

### OVERALL DIMENSION - DZ4, DZ6











Dimension in mm	DZ4	DZ6
Α	228.1	243.1
В	263.1	283.1
С	233.9	237.2
D	213	216.3
E = L	160.5	155
F	66.5	NA
G	18	NA
Н	220	282
J	264.6	270.3
K	224.3	229.2

#### **DIMENSION WITH SPREADER LINK**







Dimension in mm	DZ4	DZ6	DZ6*
Α	317	460	390
В	283	390	350
С	61	80	66
D <sub>1</sub>	157	210	172
$D_{\!\scriptscriptstyle 2}$	218	290	238
E	43	65	45
F	17	20	20
G	35	50	40


<sup>\* 26</sup>mm Clearance between Spreaders


#### **DZ Drawout - Fixed Kit**


#### **OVERALL DIMENSIONS - DZ7**













	DZ4	DZ6	DZ7
A(mm)	205	207	212.5

#### **DIMENSION WITH SPREADER LINK**






Dimension in mm	DZ4	DZ6	DZ7
Α	317	430	519.6
В	283	390	489.6
С	61	80	80
D <sub>1</sub>	157	210	210
$D_{\scriptscriptstyle 2}$	218	290	290
E	43	65	90
F	17	20	15
G	35	50	50


<sup>\* 26</sup>mm Clearance between Spreaders


#### **BEZEL ASSEMBLY & DOOR CUTOUT DIMENSION**

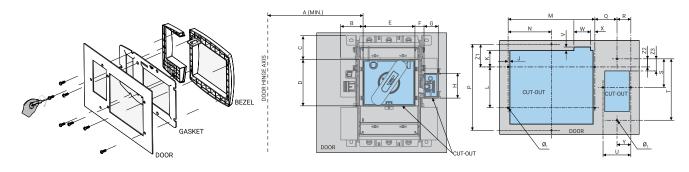


Dimension			DZ6		DZ7	
in mm	3P	4P	3P	3P 4P		4P
A (min.)*	1	70	18	35	210	
В	56.4	914	53.4	96.4	65.9	130.9
С	5:	2.5	60	).7	7	2
D	8	38	13	30	14	14
Е	1	05	12	23	16	53
F	1	9.7	9	.3	23	3.2
G	2	17	4	7	4	7
Н	7	79	7	9	7	9
J	5	5.1	į	5	3	.5
K	ğ	).9	22	22.5		2
L	78.2		78		80	
М	125.2		140		170	
N	NA		N	NA		5
Р	NA		NA		168.2	
Q	1	8.2	21		43.4	
R	3'	9.7	36		27.3	
S	5	7.3	61		73.3	
Т	1	13	122		120	
U	r	na	NA		54.6	
V	١	NA .	NA		33	
W	١	۱A	N	Α	-	7
Х	١	NA .	N	Α	Į.	5
Υ		8	2	3	27	7.3
Ø <sub>1</sub>	3	3.3	3	.3	3	.3
Ø <sub>2</sub>	7	7.3	7.3		7	.3
Z1		-	-		44	l.1
Z2		-	20.9		15	5.6
Z3		-	13		23.4	

### **Mechanical Interlocking Kit - Front Slider**

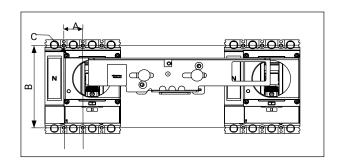




	DZ1	DZ2	DZ4
Α	25	25	35
В	114	114	126
С	M3.5	M3.5	M4
D	98.8	114.6	123.8

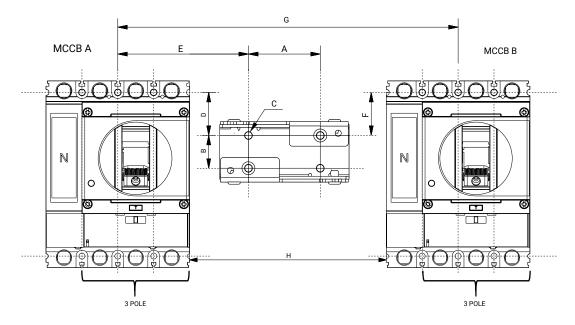


	DZ1-DZ1	DZ2-DZ2	DZ4-DZ4	DZ2-DZ4	DZ4-DZ2
Α					
В					
С					
D	3	0	34	30	34
Е	90	91	99	91	99
G	235	237	245	237	245
Н	135 137		105	117	125
F	3	0	34	34	30

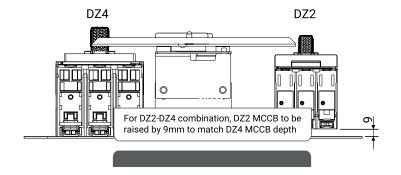



#### MCCB INTERLOCKING MATRIX

мссв			В	
		DZ1	DZ2	DZ4
	DZ1	✓		
А	DZ2		✓	✓
	DZ4		✓	✓

### **Mechanical Interlocking Kit - Rear Base Plate with Cable**



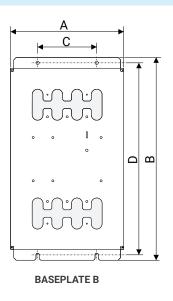





	DZ1	DZ2	DZ4	DZ6
DZ1	✓			
DZ2		✓	✓	✓
DZ4		✓	✓	✓
DZ6		✓	✓	✓

#### **CABLIE SELECTION MATRIX**

		DZ	Z1	DZ	<b>Z2</b>	DZ	<b>Z</b> 4	DZ	Z6
		Α	В	Α	В	Α	В	Α	В
DZ1	Α	L	L						
DZI	В		М						
DZ2	Α			L	L	L	М	L	L
DZZ	В				М	L	М	М	Н
D74	Α					L	М	L	М
DZ4	В						Н	М	Н
574	Α							М	Н
DZ6	В								Н

	OVERALL DIMENSIONS									
	BA	SEPLATE	Α	BASEPLATE B						
	DZ1/2	DZ4	DZ6	DZ1/2	DZ4	DZ6				
Α	100	160	170	164	213	230				
В	222	264	334	282	349	412				
С	70	94	104	75	105	120				
D	204	242	312	264	327	390				

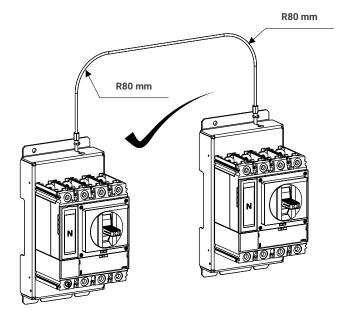






- 1. No sharp bending or looping/bundling of cable during or after assembly
- 2. Ensure no free hanging of cable.
- 3. Cable should be supported appropriately at required locations.
- 4. Ensure no sagging of cable.

All dimensions are in mm

#### **OVERALL DIMENSIONS**

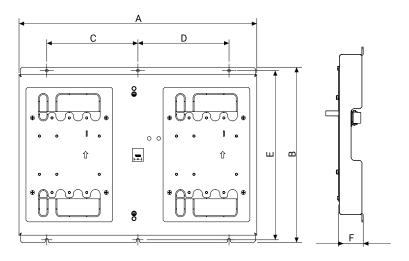


#### MCCB INTERLOCKING MATRIX

	DZ4	DZ6
DZ4	✓	✓
DZ6	✓	✓


	OVERALL DIMENSIONS			
	DZ4	DZ4 DZ6		
А	455	548		
В	339	404		
С	170	210		
D	170	210		
Е	323	390		
F	57	57		

### **Mechanical Interlocking with Key Locks**

#### **OVERALL DIMENSIONS**




#### DOOR CUTOUT DETAILS




Minimum panel depth for Rotory Operating Mechanism with panel mounted key lock

#### **OVERALL DIMENSIONS**



МССВ	Length of shaft (LS)	Min Panel Depth
DZ0	L-96	220
DZ1	L-102-5	225
DZ2	L-114.5	240
DZ4	L-132	260


#### OVERALL DIMENSIONS




МССВ	Length of shaft (LS)	Min Panel Depth
DZ6	L-160.2	272
DZ7	L-172.4	284

### **Electrical Operating Mechanism**


### DZ1

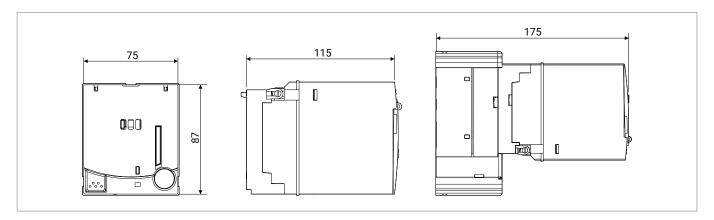


### DZ2

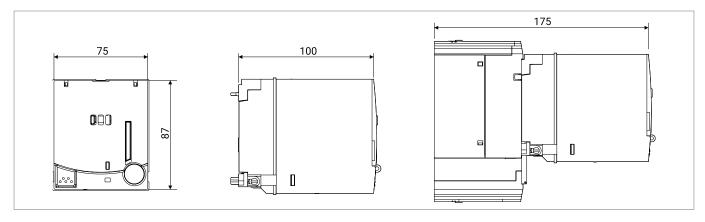


### DZ6

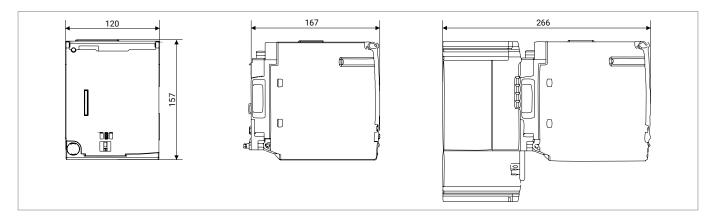

### DZ7

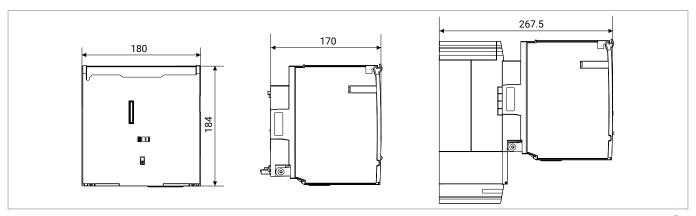


### **Mounting Dimensions**

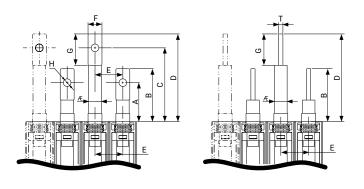


	DZ1	DZ2 DZ4		DZ6	DZ7	
	160A	160A	250A	400A	630/800A	
A5	7.34	9.54	4.65	66	4	
В6	8.36	0.55	5.67	68	9	
C1	07.3	99.5	94.6	106	114	
D1	18.3	110.51	05.6	126	139	
AE	9.59	.5	13	18	22	
E2	52	53	5	40	60	
F1	21	21	8	20	30	
G2	25	52	5	45	55	
Н	6.5	6.5	9	11	12.5	
Т3		36		6	10	

### **Mounting Plate for DZ1/2**

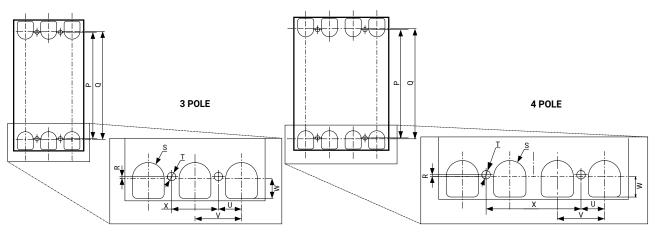


### **Mounting Plate Dimensions**

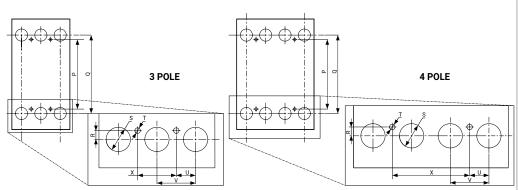

		Without Plug-in		With Plug-in	
		DZ1/2 DZ4		DZ1/2	DZ4
		160A	250A	160A	250A
Р		114	126	151	181
Q		116	142	157	197
R 1 8 3		3	8		
S		R 8.5	22	R17	22
Т		4.5	5	4.5	5
U		12.5	17.5	12.5	17.5
V		25	35	25	35
W		10.8	-	10.8	-
Х	3 Pole	25	35	25	35
^	4 Pole	50	70	50	70


### **Mounting Plate Dimensions**

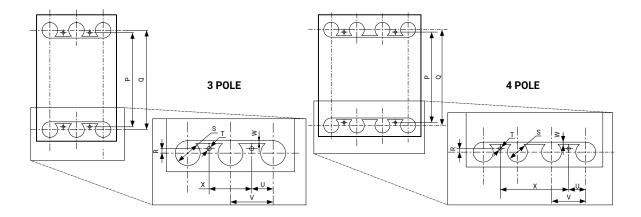


### **MOUNTING PLATE DMENSIONS**

		Without	With Plug-in		
		DZ6	DZ7	DZ6	
		400A	630A/800A	400A	
ŀ	)	172	212	88	
(	Q	183.4	223.8	260	
F	₹	5.7	5.9	86	
S		25	35	25	
-	Γ	5.5	6	5.5	
U		20	30	9	
V		40	60	40	
W		3	4	3	
Х	3 Pole	40	60	98	
	4 Pole	80	120	138	

All Dimension are in mm

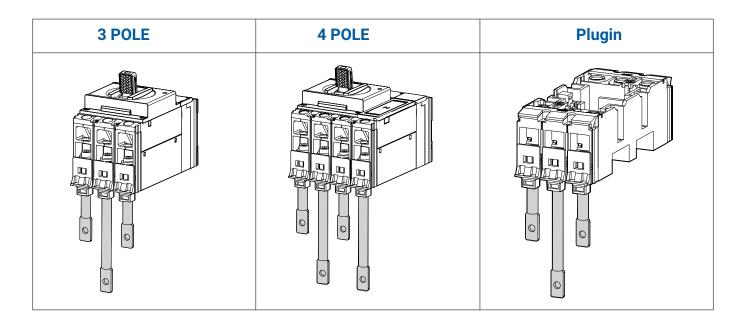

### **Mechanical Interlocking Kit - Front Slider**

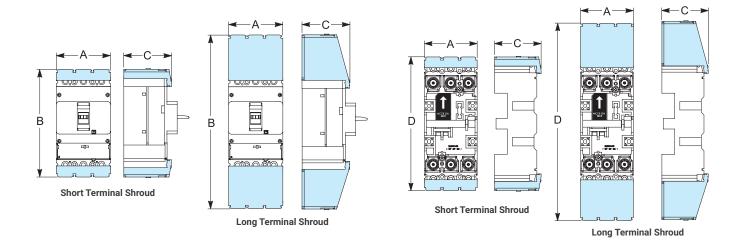

mm	Configuration	Pole	Α	В	С	D
	Short Terminal Shroud	3P	76.6	150.8	63.7	-
DZ0	Short Terminal Shroud	4P	101.6	150.8	63.7	-
D20	Laws Tawasin at Observed	3P	76.6	235	63.7	-
	Long Terminal Shroud	4P	101.6	235	63.7	-
	Short Terminal Shroud	3P	76.6	150.8	63.7	191.8
D71/D72	Short Terminal Shroud	4P	101.6	150.8	63.7	191.8
DZ1/DZ2	Long Torminal Chroud	3P	76.6	235	63.7	-
	Long Terminal Shroud	4P	101.6	235	63.7	-
	Short Terminal Shroud	3P	105	179	90.5	234
DZ4		4P	140	179	90.5	234
024	Long Terminal Shroud	3P	105	305	90.5	-
		4P	140	305	90.5	-
	Short Terminal Shroud	3P	120	221	104.4	298
DZ6		4P	160	221	104.4	298
D26	Long Terminal Shroud	3P	120	345	104.4	-
		4P	160	345	104.4	-
	Short Terminal Shroud	3P	180	265.4	103.6	353.4
		4P	240	265.4	103.6	353.4
DZ7	Law Tamain J.Ohman	3P	180	390	103.6	-
	Long Terminal Shroud	4P	240	390	103.6	-

# **Electrical Standard Products (ESP) Offices**

#### **HEAD OFFICE**

Lauritz Knudsen Electrical & Automation, A/600, Shil-Mahape Road, TTC Industrial Area, MIDC Thane, Navi Mumbai, 400 710, Maharashtra. Tel: 022-6722 6300 | Fax: 022-6705 1112 | e-mail: CIC@LK-EA.com

#### **BRANCH OFFICES**

Lauritz Knudsen Electrical & Automation C-201, The First Commercial Complex, B/S Keshavbaug Party Plot, Vastrapur, Ahmedabad - 380 015 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation Wework Central, #36 Infantry Road, Bengaluru - 560 001 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation Workloop Unit-612, 6th Floor, Esplanade One, Rasulgarh, Bhubaneswar, Odisha-751010 Phone No: 022 6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation, The Executive Centre Level 8, Olympia Teknos Park 28, SIDCO Industrial Estate, Guindy, Chennai - 600 032, Tamil Nadu, Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation Playworkz Coworking Space 43 & 44, 3rd Cross, Bharathy Colony, Peelamedu, Coimbatore - 641 004 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation 3rd Floor, 1&2 Vijay Park, Main Chakrata Road, Opp. Anandam, Near Ballupur chowk, **Dehradun - 248 001** Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation Ground Floor, B-27, Biplab Rashbihari Sarani, Sector 2A, Bidhan Nagar, **Durgapur - 713 212** Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation 6th Floor, Exotica Greens, A Block, 191, R G Baruah Road, Guwahati Central, **Guwahati - 781 005** Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation Shri Daneshwari, 1st Floor Plot No. 17, 2nd Cross, Near Old Income Tax Office Road, Vidyanagar, **Hubballi - 580 021** Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation AWFIS Space Solutions, Prestige Phoenix, 4th floor, 1405, Umanagar, Begumpet, Hyderabad - 500 016
Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation Workie, 214 - 2nd Floor, Apollo Premier, PU-4, Scheme No. 54, Vijay Nagar Square, Indore - 452 010 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation Office No. 430, 4th Floor, Jaipur Electronic Market, Riddhi Siddhi, Gopalpura Bypass, Jaipur - 302 018 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation GDR Siddha, Ground Floor, N Road Bistupur, Opposite St. Mary's Church, Jamshedpur - 831 001 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation **Business Communication Centre** 2nd Floor, Chiramel Chambers, Kurisupally Road, Ravipuram, Kochi - 682 015 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz & Knudsen Electrical & Automation, 207, 2nd floor, Revolution Complex, Station Road, E Ward, Next to Pedestrian Bridge, **Kolhapur - 416 001** Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation 2nd Floor, BN3, Salt Lake, Sector-V, **Kolkata - 700 091** Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation No.10, Fortuna Towers, 2nd Floor, Rana Pratap Marg, Near NBRI, Lucknow - 226 001 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation El Dorado Building, 3rd Floor, 6, Venkatraman Street, Chinna Chokkikulam, Madurai - 625 002 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation Bestech Business Park, Tower - A. 2nd floor, Sector - 66 Mohali - 160059 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation TC II, Tower B, PRIMA BAY Gate No. 5, Saki Vihar Road Powai, Mumbai - 400 072 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation Unnati Building, 2nd Floor, Automation Campus, A-600, TTC Industrial Area Shil-Mahape Road, Mahape, Navi Mumbai - 400 710 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation M1 & M2, Mezzanine Floor, Himalaya Excellency, Plot No. C-47, Pratap Nagar Square, Nagpur - 440 022 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation, 3rd floor, Uttam Tower by Viraj Estate, Sharanpur Road, Nasik - 422 002 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation A-25, 1st Floor, Imperia Complex. Mohan Corporative Industrial Estate, Near Sarita Vihar Metro Station, Mathura Road,

New Delhi - 110 044 Phone no: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation A06/A07, Second Floor, Grand Chandra Complex, Frazer Road Patna - 800 001 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation UrbanWrk, 5th Floor, Sai Radhe, Raja Bahadur Mill Road, Behind Hotel Grand Sheraton, Sangamwadi Pune - 411 001 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation Office No. 211 & 212, Pithalia Plaza, KK Road, Near Fafadih Chowk, Raipur - 492 001 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation, DevX 4th Floor, A Wing, Om 9 Square, 150 Ft Ring Road, Near Nana Mava Circle, Opp Silver Heights, Rajkot - 360 001 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation 10th Floor, Titaanium Business, Bhimrad Road, Althan Surat - 395 017 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation 11th Floor, Block-D, Notus IT Park, Sarabhai Campus, Bhailal Amin Marg. Vadodara - 390 023 Phone No: 022-6932 7800 e-mail: CIC@LK-EA.com

Lauritz Knudsen Electrical & Automation Naga Chambers, 3rd Floor, D/No. 12-1-16, Plot No. 49, Survey No. 1051, Waltair Main Road, **Visakhapatnam - 530 002** Phone No: 022-6932 7800

e-mail: CIC@LK-EA.com

Product improvement is a continuous process. For the latest information and special application, please contact any of our offices listed here. Product photographs shown for representative purpose only.



Lauritz Knudsen Electrical & Automation, Electrical Standard Product

A/600, Shil-Mahape Road, TTC Industrial Area, MIDC Thane, Navi Mumbai, 400 710, Maharashtra, Phone No: 022-6722 6300 | Web: www.LK-EA.com

Customer Interaction Center (CIC) Phone no: 022-6932 7800

Web: www.LK-EA.com | e-mail: CIC@LK-EA.com

